

3368  
NBSIR 86-0000

DIU-711 Ext-2720  
Pages 46

ANALYSIS OF PVRC 251J SECTIONING DATA (1984) AND ROUND ROBIN ULTRASONIC TEST  
DATA (1968) FOR ESTIMATING RELIABILITY OF FLAW FABRICATION AND NDE PROCEDURE

---

Jeffrey T. Fong, P.E.

Mathematical Analysis Division  
National Bureau of Standards  
U. S. Department of Commerce  
Gaithersburg, MD 20899

Tel. (301) 921-2631

FILE COPY  
DO NOT REMOVE

February 10, 1986 (Final Report)

Prepared for:

Pressure Vessel Research Committee (PVRC)  
of the Welding Research Council (WRC)

United Engineering Center  
345 East 47th Street  
New York, NY 10017

Not Approved for  
Public Release



Analysis of PVRC 251J Sectioning Data (1984) and Round Robin Ultrasonic Test Data (1968) for Estimating Reliability of Flaw Fabrication and NDE Procedure

Jeffrey T. Fong, P.E.

Mathematical Analysis Division  
National Bureau of Standards  
Gaithersburg, MD 20899

Abstract:

Based on the 1984 sectioning data of an 11-inch thick plate weld specimen containing 15 implanted flaws, and the round robin ultrasonic testing data of that specimen for flaw detection by 5 teams using a 1968 ultrasonic testing procedure (UT-1968), the reliability of flaw fabrication in a test specimen for dimensional stability and that of a flaw detection procedure, UT-1968, are assessed.

The analysis uses an expert-system approach where mainframe and personal computer (PC) software for database, graphics, and analysis are integrated with decision-support criteria for a problem-specific automated data analysis methodology.

The main results of the reliability study are:

- (a) The flaw fabrication procedure is dimensionally unsatisfactory for cross cracks and longitudinal cracks, but is "reliable" for slag inclusions if a size amplification factor of 2 is acceptable.
- (b) The detection threshold for zero false call probability is 2.0 inches for teams A, B, and C using the UT-1968 procedure.
- (c) The ultrasonic detection procedure, UT-1968, is less than 90% reliable if the prescribed threshold for a true flaw to be in the neighborhood of an indication is 2.0 inches (center-to-center).

Significance of these results and the analysis methodology in assessing and improving weld flaw detection procedures is discussed.

Keywords: Analysis of variance; confidence level; data analysis; database management; flaw fabrication reliability; NDE reliability; reliability modeling; round robin test; statistical analysis; tolerance factors; ultrasonic testing; weld flaw detection.

## ACKNOWLEDGMENT

The work reported in this document resulted from a research project on an analysis methodology for engineering data that began in 1976 at the Center for Applied Mathematics (CAM) of the National Bureau of Standards (NBS). From 1978 to 1985, the project was also supported by the NBS Office of Nondestructive Evaluation. Beginning in October 1982, the Pressure Vessel Research Committee (PVRC) of the Welding Research Council, New York, NY, co-sponsored an application of the analysis methodology to a specific set of PVRC data through a contract to NBS.

I would like to thank J. J. Filliben of CAM, the architect and developer of the DATAPLOT software, for his substantial technical contribution and timely assistance to the completion of this work. I am grateful to Dr. S. H. Bush of Battelle Pacific Northwest Laboratories, Richland, WA, O. H. Hedden of Combustion Engineering, Windsor, CT, and Dr. S. Yukawa of General Electric Company, Schenectady, NY, for their input and guidance to the formulation of the problem during 1981-86 when they served on the PVRC Subcommittee on NDE of Pressure Components.

In addition, I am also grateful to the following individuals at NBS and PVRC whose assistance facilitated the completion of my research on both the analysis methodology and the PVRC application:

NBS: P. D. Barnett, H. Berger\*, E. Bromberg, R. S. Cramer\*,  
K. R. Eberhardt, D. G. Eitzen, E. N. Fong, F. C. Johnson,  
B. W. Kave, M. R. Knapp-Cordes, J. A. Lechner, S. D. Leigh,  
J. Mandel, L. Mordfin, D. F. Redmiles, J. R. Rosenblatt,  
J. H. Smith, S. L. Stewart, and H. T. Yolken.

PVRC: F. C. Berry, M. M. Behraves, R. A. Buchanan, C. D. Cowfer,  
S. Crutzen, L. J. Chockie, C. R. Felmley, Jr., H. C. Graber,  
R. W. Nichols, E. H. Ruescher, Y. Saiga, and J. Watanabe.

## DISCLAIMER

The names of computer systems or software products mentioned in this report imply neither approval nor endorsement by the author or the organizations that support this work.

---

\* Name of an individual who has since left NBS.

## Table of Contents

Abstract .. .. .	i
Acknowledgment .. .. .	ii

<u>Section</u>	<u>Page</u>
1. Introduction .. .. .	1
2. Overview of an NDE Data Analysis Methodology ..	2
3. Analysis of 251J Sectioning Data .. .. .	4
4. Reliability of Flaw Fabrication .. .. .	6
5. Verification of Round Robin UT-1968 Data ..	7
6. Analysis of Individual Team UT-1968 Data ..	8
7. Analysis of 3-Team UT-1968 Data .. .. .	10
8. Reliability of UT-1968 Procedure .. .. .	11
9. Discussion & Future Work .. .. .	11
10. Conclusion .. .. .	12
11. References .. .. .	13
List of Tables .. .. .	17
List of Figures .. .. .	31





# Analysis of PVRC 251J Sectioning Data (1984) and Round Robin Ultrasonic Test Data (1968) for Estimating Reliability of Flaw Fabrication and NDE Procedure

Jeffrey T. Fong, P.E.

## 1. Introduction

Since the early 1960's, the reliability of the nondestructive evaluation (NDE) of critical structures for flaw detection, location, and sizing, has been of considerable interest to the engineering community and the public at large.

Two events were generally credited by engineers for motivating them to accelerate the development of the art and technology of NDE into a discipline where generic questions on NDE capabilities could be carefully examined and answered.

The first came from a demand for better NDE in the space and nuclear industries where safety considerations were given a higher priority. The second was due to the significant advances in fracture mechanics where "under-sized" flaws in non-critical regions of components or structures were shown to be acceptable during service, and the burden of implementing this theory fell on the NDE engineers for improving the reliability of not only detecting flaws but also locating and sizing them through new techniques and procedures.

As part of the industry's response to this need, the Pressure Vessel Research Committee (PVRC) of the Welding Research Council initiated in 1965 a long-term research program where 12 plate-weld specimens containing carefully designed and implanted flaws were fabricated and inspected by qualified teams using techniques and procedures then-approved by PVRC.

In Table 1, we list the key attributes of the 12 PVRC weld specimens as documented by Hedden (1981) and subsequently updated to include the sectioning results of Yukawa (1981, 1983, 1984) and Saiga (1983, 1984b).

The availability of sectioning data for specimen 251J in early 1981 created an opportunity to answer two types of questions on NDE reliability. First of all, since specimen 251J was designed to contain 15 flaws of 4 different types, a comparison of the sectioning with the intended flaw location and sizing data could yield an estimate of the reliability of the flaw fabrication procedure.

Secondly, the round robin ultrasonic testing data of 251J as first analyzed by Buchanan (1976) under the assumption that the intended flaw location data were valid, need to be re-evaluated using the sectioning data to arrive at a more realistic estimate of the reliability of the 1968 ultrasonic testing procedure.

Following the release of the final sectioning data of specimen 251J by Yukawa (1984), the Center for Applied Mathematics of the National Bureau of Standards (NBS) undertook a two-year collaborative research project with PVRC to accomplish the following three goals:

- (a) To conduct a flaw fabrication reliability analysis based on the final sectioning data of 251J and a classical analysis technique known as the analysis of variance (ANOVA) first introduced by Daniels (1939) and later discussed by many including Crump (1946), Eisenhart (1947), Hendricks (1951) and Mandel (1971).
- (b) To re-analyze the round robin ultrasonic testing data of 251J (1968 PVRC procedure) by using the newly reported sectioning data rather than the old intended flaw data and by applying a new NDE reliability analysis technique recently proposed by Fong and Filliben (1986).
- (c) To interpret and discuss the above two results not only for their intrinsic value in assessing the reliability of two procedures that were of the state of the art twenty years ago, but also for illuminating the value of an analysis technique in extracting information from round robin data that could assess and improve a class of test procedures involving sophisticated instrumentation and trained personnel such as the ultrasonic flaw detection system.

## 2. Overview of an NDE Data Analysis Methodology

The analysis technique mentioned in items (a) and (b) above and described in details in a companion paper (Fong and Filliben, 1986), was developed as part of a research project that grew out of a 1976 National Bureau of Standards (NBS) study on the structural integrity of hundreds of girth welds of the Trans-Alaska Oil Pipeline (Berger and Smith, 1976). The pipeline study was undertaken by NBS at the request of the U.S. Department of Transportation (DOT) in anticipation of the pipeline owner's request to waive then federal regulations on the non-acceptance of welds containing known defects. One of the main conclusions of the study reads as follows:

"Defect dimensions can be determined with sufficient accuracy to be useful in the fracture mechanics analysis if the radiographs are made under carefully controlled conditions. If the radiographs are not made with close control, the accuracy of the defect sizes may not be sufficient to permit their use in establishing allowable defect sizes."

Since the field radiographs furnished by the pipeline owner were not made with close control, DOT concluded from the NBS study that there was not enough technical basis to grant the proposed waiver. All defective welds except three buried under a river crossing were required to be repaired at a cost close to one hundred million dollars.



An interpretation of the NBS study, as recently documented by Fong (1986a), identified two research needs that were not met in 1976 to support a stronger statement on the effectiveness of flaw sizing using field radiographs. Those two needs were:

(a) Database Need - A round robin pipeline weld flaw detection, location, and sizing database using field radiographs not necessarily made with close control but under a state-of-the-art procedure approved by the regulator.

(b) Analysis Need - An analysis methodology for converting those round robin data into defect detection, location and sizing reliability estimates applicable to new data compatible with the round robin database.

Following the 1976 study, the database need was interpreted to include ultrasonic test data to take advantage of the PVRC round robin program, and the analysis need was addressed in a number of NBS studies that were documented by Fong (1978), Fong and Dowling (1981), and Fong and Filliben (1986). With the aid of computer software in both the mainframe and the personal computer (PC) environment, an NDE data analysis methodology was designed to include the following four phases of computation:

<u>Phase</u>	<u>Task</u>	<u>Remarks &amp; References</u>
I -	Data Representation for Expert-Guided and Computer-Aided Screening.	Database Management; Graphics Software (Filliben, 1984).
II -	Data Distribution Testing for both symmetric and asymmetric families.	(Filliben, 1969; Joiner & Rosenblatt, 1971; Filliben & Fong, 1984).
III -	Data Analysis for Evaluating Effects of Certain Parameters in a Round Robin Test Program.	Analysis of Variance (Draper & Smith, 1981; Filliben, 1984).
IV -	Estimation of Confidence Levels for a specific test procedure, coverage, and control parameter.	Tolerance Factors (Proschan, 1953; Beyer, 1966).

To exercise the analysis methodology, a suitable set of round robin ultrasonic testing data for PVRC specimen 251J (Gillette and Smedley, 1968; White, 1968; Buchanan, 1976; Ruescher and Graber, 1981) of which the sectioning data (Yukawa, 1984) were available, was chosen. The results of this exercise and a discussion of their implications constitute the main body of this report.

### 3. Analysis of 251J Sectioning Data

PVRC specimen 251J was fabricated by welding two 11-inch thick plates of ASTM A-533-65, Grade B, low-alloy steel (80,000 psi tensil strength), using the submerged arc welding process. The dimensions of the specimen and a sketch of the relative locations of the 15 implanted flaws are given in Figs. 1 and 2. Of the 15 flaws, 5 were longitudinal cracks (LC), 5 cross cracks (CC), 3 long slag inclusions (LS) and 2 short slag inclusions (SS). The geometry of each flaw before sectioning was represented as a simple rectangular box with coordinates of its 6 planes given in Table 2.

As expected, the actual shape and location of each flaw after sectioning were quite complicated. In Fig. 3, we show the actual outline of a cross crack (flaw A) in two projections as first reported by Yukawa (1981). Assuming that the crack is a 2-dimensional curved surface embedded in a 3-dimensional space with each section in the x-z plane represented by a straight line in a preferred direction, a computer-aided graphical representation of the actual flaw A was accomplished by Fong (1982) as shown in Figs. 4 and 5.

To facilitate an in-depth analysis of the sectioning data versus the intended (Table 2), Yukawa (1983, 1984) reported a simplified representation of the sectioning data as shown in Table 3. Using an NBS-developed graphics-and-analysis-integrated software named DATAPLOT (Filliben, 1984), we show in Figs. 6 to 9 the box-type representation of each of the 15 flaws as found by sectioning. A comparison of the intended flaw location vs. sectioning data as projected on the y-z plane is shown in Fig. 10.

A visual inspection of Fig. 10 shows that the flaw fabrication procedure of the early 1960's was "not good." Our attempt here is to show that an analysis of the sectioning data can yield a quantitative statement on the effectiveness of the flaw fabrication procedure.

Let us consider a measure of the effectiveness of the procedure by defining a flaw size amplification factor (AF) equal to ratio of the actual maximum dimension of an implanted flaw to the intended maximum. In this case, we may consider the intended maximum dimension of each flaw as unity, and the amplification factor AF is the normalized variable for an analysis involving a sample of 15 data as shown below:

<u>Cross Crack</u>	<u>A</u>	<u>E</u>	<u>I</u>	<u>J</u>	<u>N</u>	
AF =	2.133	2.667	2.467	2.000	1.733	
<u>Longit. Crack</u>	<u>C</u>	<u>D</u>	<u>H</u>	<u>L</u>	<u>M</u>	
AF =	1.575	1.650	2.750	2.375	2.200	
<u>Long Slag</u>	<u>B</u>	<u>G</u>	<u>O</u>	<u>Short Slag</u>	<u>F</u>	<u>K</u>
AF =	1.000	1.300	1.225	AF =	1.467	1.267

The analysis of the 15 maximum flaw dimension data (normalized) consists of four distinct steps as outlined below:

### Step 1    Univariate Analysis

In this analysis, we consider a sample of 15 data which are equally representative of the quality of the flaw fabrication procedure. A histogram of the data is given in Fig. 11. The sample average (M) is 1.854, and the sample standard deviation (S) is 0.560. Assuming that the data follows a normal distribution, a plot based on the computed M and S is also given in Fig. 11.

### Step 2    Distribution Testing

In Fig. 12, we present a probability plot of the data which appears to justify the assumption that the distribution is normal. Using a standard DATAPLOT routine based on Tukey's Lambda Test for families of symmetric distributions (Filliben, 1969; Joiner-Rosenblatt, 1971), we show in Fig. 13 that the correlation coefficient for the distribution to be normal is 0.98 which is close enough to unity to justify the normality assumption.

### Step 3    Box Plot for Testing Homogeneity of Data

To examine whether the 15-data set is reasonably homogeneous even though it involves four types of flaws, we used a DATAPLOT routine called "boxplot" and display the results in Fig. 14. A visual inspection led us to conclude that there appears to be an effect due to flaw type with the fabrication procedure reasonably reliable for both types of slag inclusions and not so reliable otherwise.

### Step 4    Analysis of Variance (ANOVA)

To determine the effect of flaw type, we conducted a one-way analysis of variance of the data set (see, e.g., Draper and Smith, 1981, pp. 423-454) by using a DATAPLOT routine called "anova." In addition to confirming that the grand standard deviation (S) equals 0.560, the analysis yielded an estimate of the standard deviation due to replication (SR) equal to 0.382.

To compute the standard deviation due to flaw type (S1), the following formula (see, e.g., Mandel, 1977) may be used if the number of replicas (denoted by m) in each subgroup is constant:

$$(S1)^2 = (S)^2 - (SR)^2 / m . \quad (1)$$

For our data, m varies from 5 for the two types of cracks to 3 for long slags and 2 for short slags. If we denote the number of types by t, and m1, m2, ... mt, the number of data in each type, we introduce an equivalent number of replicas (mm) as the integer closest to and greater than the average of all the m's. In other words,



$$mm = \text{INT} \{ (m_1 + m_2 + \dots + m_t)/t + 0.5 \}. \quad (2)$$

For  $t = 4$ ,  $m_1 = m_2 = 5$ ,  $m_3 = 3$ ,  $m_4 = 2$ , we found that the equivalent number of replicas for a constant- $m$  ANOVA equals 4. Applying equation (1) with  $m = 4$ ,  $S = 0.560$ ,  $SR = 0.382$ , we obtained  $S_1 = 0.481$ . We concluded that there was indeed a flaw type effect and the 15-data set was not homogeneous.

To incorporate the effect of flaw type, as represented by  $S_1$ , into a new estimate of the variance of the data set, let us combine the standard deviations due to replication and the flaw type into a revised standard deviation, denoted by  $S_2$ , as shown below:

$$(S_2)^2 = (SR)^2 + (S_1)^2. \quad (3)$$

For the 15-data set under consideration,  $S_2$  was found to be 0.614, which was about 10% higher than  $S (= 0.560)$  of the univariate analysis. A comparative plot of two normal distributions, one with and the other without estimating the so-called between-type variability, is given in Fig. 15.

#### 4. Reliability of Flaw Fabrication

Since we have verified that the set of data for a 15-flaw and 4-type sample is normally distributed, we can estimate the upper and lower limits of the global mean and standard deviation of the amplification factor by using tables of values of the  $t$ - and chi-square distributions, respectively. Graphical plots of those limits for a range of confidence levels between 50% and 95% are given in Figs. 16 and 17.

Let us assume that one can estimate the reliability of flaw fabrication by concentrating on the variability of a single measure, namely, the amplification factor. Knowing the upper limits of that factor for either its global mean (Fig. 16) or global standard deviation (Fig. 17), is not enough to make a judgment of the fabrication process. Following Proschan (1953) and using the tables of tolerance factors  $K$  furnished by Beyer (1966, pp. 31-35) for various sample size  $N$  (2, 3, ..., infinity) and four discrete values of the "coverage" or proportion  $P$  of the universe ( $P = 0.75, 0.90, 0.95, 0.99, 0.999$ ), we can estimate the reliability of the flaw fabrication procedure as the probability or confidence level (CL) between 75% and 99% such that at least a proportion  $P$  of the distribution will be included between  $M - K S$  and  $M + K S$ . Since Beyer's tables are for discrete values of CL (0.75, 0.90, 0.95, 0.99), we used an interpolation routine (Fong and Filliben, 1986) to obtain a continuous set of numbers for specific sample sizes ( $N = 15, 5$ ) as shown in Figs. 17 and 18. We also reprint Beyer's tables for CL = 0.90, 0.95, and 0.99 in Tables 4, 5, and 6 to facilitate their applications for samples sizes different from 15 or 5.

Using  $M = 1.854$  and  $S = S_2 = 0.614$  to account for the effect due to flaw type, we show in Fig. 20 the plots of reliability versus the upper limit  $(M + K S)$  of the amplification factor for three values of coverage ( $P = 0.90, 0.95, 0.99$ ) as estimated from a 15-flaw sample. More specifically, the flaw fabrication procedure for the four flaw types considered in the 15-data sample is said to be 90% reliable in amplifying the maximum flaw dimension to at most 3.5 if the proportion of coverage is limited to 95%.

This above estimate may be used to accept or reject a procedure if a criterion is established compatible with the tolerance factor approach. For instance, if the acceptable maximum amplification factor is 2.0 and the acceptable reliability is 90% for a 95% coverage, then the above analysis yields the conclusion that the procedure is not acceptable.

The same analysis methodology can now be used to determine the reliability of the fabrication procedure for each type of flaws. For convenience, we choose to work with 3 types instead of 4 by combining the two types of slugs into one such that the sample size of each type, i.e., cross cracks, longitudinal cracks, and slag inclusions, is 5, and the tolerance factor curves of Fig. 19 can be used in each case. The reliability plots for each flaw type can be found in Figs. 21, 22, and 23. The amplification factors for a 90%-reliability and 95%-coverage specification are found as follows:

<u>Type of Flaws</u>	<u>Upper Limit of Amplification Factors</u>	<u>Reference</u>
All Flaw Types	3.5 (90%-Reliability; 95%-Coverage)	Fig. 20.
Cross Cracks	3.7 ( - do - )	Fig. 21.
Longit. Cracks	4.2 ( - do - )	Fig. 22.
Slag Inclusions	2.0 ( - do - )	Fig. 23.

The above result allows us to conclude that if the acceptance criterion is 2.0, the fabrication procedure passes for slag inclusions but not for cross cracks or longitudinal cracks.

## 5. Verification of Round Robin UT-1968 Data

We now report the results of the second portion of this study, namely, the re-evaluation and reliability modeling of the 1968-procedure of ultrasonic detection of flaws in a thick-section steel weld. The study involved the use of the 5-team round robin data of specimen 251J (Gillette and Smedley, 1968; White, 1968) and the 1984 sectioning data by Yukawa (1984, 1986). The analysis methodology (Fong and Filliben, 1986) is also based on the application of ANOVA and the use of tolerance factor tables.

In Tables 7 through 11, we reprint the ultrasonic test (1968-procedure) data (UT-1968) for teams A, B, C, D, and F, respectively. We show in Figs. 24 through 28 the y-z projections of the data as a pre-analysis quality check.

In Fig. 24, we observed that eight of the 18 indications by team A fell outside the physical bounds of the specimen. The data were sent to the PVRC Subcommittee on NDE of Pressure Components for re-examination, and a revised set by Hedden (1984a) as shown in Table 12 and Fig. 29 was used for further analysis. Following a closer reading of more subcommittee documents, Hedden (1984b) further revised the team A data as shown in Table 13 and Fig. 30. A visual comparison of Figs. 24, 29, and 30 shows the importance of an expert-assisted and computer-aided data quality check before any major step of analysis is undertaken.

An examination of Figs. 25 and 26 for the 4-indication data set of team B and the 14-indication data set of team C, respectively, led us to conclude that both sets were acceptable. Questions were raised with the PVRC Subcommittee on NDE regarding the acceptability of data sets for teams D and F (see Figs. 27 and 28), and were not fully resolved by a communication due to Hedden (1985). As a first step toward the application of the analysis methodology to PVRC UT-1968 data, it was proposed by the author and approved by PVRC that the remaining portion of this study be limited to the use of the full data sets of teams A, B, and C for studying reliability, and one specific indication from the data set of team D for discussing shortcomings of the analysis methodology.

## 6. Analysis of Individual Team UT-1968 Data

To emulate the decision-making process of matching a UT indication with the actual locations of the 15 implanted flaws, we initiated the design and implementation of a detection-analysis software (Fong and Filliben, 1986), where the database management capability of a personal computer (PC), and the analysis capability of a mainframe or mini-computer using DATAPLOT (Filliben, 1984), were integrated. The results of the analysis for three typical indications of team A, one of team B, two of team C, and one of team D, are given in Figs. 31 through 37. The analysis may be described as a two-part exercise where the first part deals with each indication as reported and is accomplished in three steps as shown below:

### Step 1 Center-to-Center Distance Computation

For this step, we convert all box-type data for the 15 implanted flaws into centroid and half-length data to facilitate the computation of the center-to-center distances (CD) between an indication and each of the 15 implanted flaws. Those fifteen CD's are then ordered in an ascending sequence for a comparison with a set of threshold values.



## Step 2 Identification of Flaws Detected vs. Threshold

Consider an ascending sequence of flaw detection thresholds between 1/4 and 3.0 inches in increments of 1/4 inch. For each value of the detection threshold and each indication, identify the flaw or flaws whose center-to-center distance(s) are equal or less than the threshold. A new sequence of positive integers is then found to characterize the detection capability of the indication as a function of the detection threshold.

## Step 3 Graphical and Text Representation of Each Indication

Plot the number of flaws detected versus the detection threshold and display the name of the nearest flaw detected, the center-to-center distance, the ratio of the maximum dimension of actual flaw to that of the detected one (size factor), and the maximum DAC value reported for the indication. Typical examples of such display are given in Figs. 31-37.

By collecting the results of the analysis for each of the indications reported, we can assess the capability of each team by introducing two detection probabilities and one activity measure, each as a function of the detection threshold, as shown below:

(a) True-Call Probability (TCP) - For each detection threshold and each indication, the above analysis allows us to answer the question whether any flaw has been identified. If the answer is yes, we assign 1 to the indication as a true call. Otherwise, we assign 0 to show it is a false call. The true-call probability (TCP) is defined as the ratio of the total number of true calls registered to the total number of indications reported. If an indication identifies more than one flaw, as in the case of Fig. 31 for threshold equal to 2.25 or greater, the true call count is still 1.

This measure allows us to define a false-call probability (FCP) by the expression  $FCP = 1 - TCP$ . Results for teams A, B, C, are reported in Figs. 38-40. A visual inspection allows one to conclude that a 2-inch threshold is enough for all 3 teams to claim a 100% TCP or 0% FCP.

(b) Flaw Detection Probability (FDP) - Among the true calls, it happens that some of the flaws were identified more than once. The purpose of introducing FDP is to eliminate the duplicate calls by counting exactly how many flaws the team has found. Thus we define the flaw detection probability, FDP, as the total number of distinct flaws detected to the total number of flaws implanted. Again, an examination of Figs. 38-40 shows that a team B did well on the TCP measure, but poorly on this measure.

(c) Activity Index (AI) - A composite index that measures a team's activity rather than efficiency is to define an activity index equal to the total number of true calls divided by the total number of implanted flaws. In Figs. 41-43, we display the results for teams A, B, C, and for different types of flaws to see if there is a flaw type effect in the ease of detectability. The answer appears to be negative, and can be justified quantitatively via an analysis of variance as shown in the next section.

## 7. Analysis of 3-Team UT-1968 Data

One of the main difficulties in assessing the reliability of a complex test procedure such as NDE is the requirement for a large quantity of data normally unavailable or economically unfeasible. The lack of an a priori knowledge of the distribution or variability of many instrument and human factors creates a barrier for a credible reliability analysis based on a small amount of round robin data.

On the other hand, if we can show that the underlying distribution of a "control variable" is normal or close to, a combination of the powerful technique of the analysis of variance (ANOVA) and the concept of tolerance factors can be applied even though the quantity of data is "small." An example of this has been presented earlier in assessing the reliability of a flaw fabrication procedure (Section 4). In this section, we shall present an analysis of the 3-team UT-1968 data by first choosing a control variable, then testing its underlying distribution, and finally applying the ANOVA to evaluate between-team, flaw-type, and DAC effects on the 3-team data.

The variable we choose to work with is the smallest detection threshold (DT) for new and distinct flaws to be detected. This variable has the practical property that the height of its histogram should be zero at  $DT = 0$  and  $DT = DTMAX$ , where  $DTMAX$  equals some large number. The question to be answered is whether the distribution of the variable using data between  $DT = 0$  and  $DT = DTMAX$  is close to normal. If that were the case, we can apply the analysis methodology to yield some information on the reliability of the NDE procedure. If not, we have no alternative but to seek more data and an alternate variable.

A histogram of the data for the above-mentioned control variable based on the analysis of the last section is given in Fig. 44. The results of the analysis for all three teams have been combined to yield a data set of sample size equal to 28. Using DATAPLOT routines for testing family of symmetric distributions (Fig. 45), Weibull distributions (Figs. 46-47), and Extreme Value distributions (Fig. 48), we found that the distribution of the control variable is reasonably normal.

We then apply the DATAPLOT routine of the analysis of variance to answer the following three questions:

- (a) Is there a between-team effect in the 3-team round robin data set?
- (b) Is there a flaw-type effect in the same data set?
- (c) Is there a DAC effect in the same data set?

The results of the one-way ANOVA for each of the above questions are given in Figs. 49-51. In each case, no effect was found in the 28-point data set. The answer for question (b) seemed reasonable since we have already observed the lack of a flaw-type effect in the results of Section 6.

## 8. Reliability of UT-1968 Procedure

To assess the reliability of the UT-1968 procedure, we follow the approach used in Section 4 by first obtaining a set of curves for the tolerance factor  $K$  for sample size equal to 28 (Fig. 52), and then plotting the upper tolerance limits  $M + K S$  for the sample of 28 data points with  $M = 1.36$  and  $S = 0.454$ . The result is shown in Fig. 53. The following may be used to quantify the reliability of the UT-1968 procedure:

<u>Case</u>	<u>Coverage</u>	<u>Reliability</u>	<u>Det. Thresh. Tol. Limit (in.)</u>
I	90 %	90 %	2.3
II	90 %	95 %	2.35
III	95 %	95 %	2.55

If the prescribed detection threshold is 2 in. for 90% coverage and 95% reliability, then the procedure fails as shown in Case I even though the sample average ( $= 1.36$  in.) is well within the prescribed threshold. The result could be used to establish a base-line for the UT procedure such that any change in the procedure could be assessed through a new round robin program by observing any changes in the upper tolerance limits.

## 9. Discussion & Future Work

We have presented two sets of results in this study. The first is on the reliability of a flaw fabrication procedure for a thick-section steel weld specimen. To our knowledge, this is the first time such result has ever been published. The use of the one-way analysis of variance technique to evaluate the reliability of the procedure for different types of flaws is both interesting and instructive. A more thorough discussion of the results of Section 4 appears in a companion paper (Fong, 1986b).

The second set of results applies to an outdated ultrasonic test procedure (UT-1968). The negative results are not surprising, since in those days the detection of flaws by NDE was more an art than an engineering discipline. The significance of the results lies more in the analysis approach and newly introduced concepts than in the conclusion that UT-1968 is unsatisfactory. A comparison of this study with an earlier one by Buchanan (1976) shows that our analysis methodology has yielded quantitative answers to at least five new questions on the UT-1968 procedure:

- (a) What is the false call probability of each team?
- (b) Is there a between-team effect?
- (c) Is there a flaw-type effect?
- (d) Is there a DAC effect?
- (e) What is the detection reliability of the UT procedure?



In addition, the analysis methodology requires a data quality check which altered the data of team A and excluded the data of teams D and F on technical grounds that are considered essential for an automated data analysis and decision-making exercise.

The interaction between PVRC as the data expert and NBS as the analyst and expert-system researcher turned out to be one of the key ingredients in a successful completion of this study. The design and implementation of the PC-based and mainframe-linked prototype software for NDE data analysis is part of an on-going NBS research project known as DATAX (Fong, Cramer, and Redmiles, 1984; Fong, 1986a). It is hoped that similar applications of the prototype software in other engineering fields would be equally successful.

As hinted in the introduction, this study has the dual role of providing some new answers to a 20-year-old problem and proving the feasibility of an analysis methodology that is still in its prototype stage. Having succeeded in answering a small number of questions on NDE reliability and demonstrating the usefulness of the methodology, we suggest that additional work could be undertaken to update old studies and assess current NDE procedures. In particular, we like to list the following as a sample of future work that needs to be completed to achieve the goals set by PVRC:

- (i) What is the location reliability of the procedure UT-1968?
- (ii) What is the sizing reliability of the procedure UT-1968?
- (iii) What are the reliabilities of procedures used in detecting other PVRC specimens with known sectioning data (Adamonis & Hughes, 1979; PISC-I, 1979a; Saiga, 1983; Saiga, 1984b)?
- (iv) Is there a human factor effect (see Behravesh and Dau, 1986)?
- (v) Is the NDE reliability results of this study compatible with similar conclusions in the literature (Lewis et al, 1978; Johnson et al, 1979; PISC-I, 1979b; Watkins et al, 1982; Saiga, 1984a and 1984c; PISC-II, 1985; etc.)?

## 10. Conclusion

The analysis of the 1984 sectioning data of PVRC specimen 251J shows that the flaw fabrication procedure is dimensionally unsatisfactory for cross cracks and longitudinal cracks, but is "reliable" for slag inclusions if a size amplification factor of 2 is acceptable.

The detection threshold for zero false call probability is 2.0 inches for teams A, B, and C using an ultrasonic test procedure then in use in 1968. The procedure, however, is less than 90% reliable if the prescribed threshold for a true flaw to be in the neighborhood of an indication is 2.0 inches (center-to-center).

## 11. References

- Adamonis and Hughes (1979) Adamonis, D. C., and Hughes, E. T., "Ultrasonic Evaluation and Sectioning of PVRC Plate Weld Specimen 201," WRC Bulletin 252, September 1979.
- Berger and Smith (1976) Berger, H., and Smith, J. H., eds., Consideration of Fracture Mechanics Analysis and Defect Dimension Measurement Assessment for the Trans-Alaska Oil Pipeline Girth Welds, Nat. Bur. of Stand. Report to U.S. Dept. of Transp., NBSIR 76-1154, Vols. I & II, Oct. 1976. Wash. DC: G.P.O. (1976).
- Behravesh and Dau (1986) Behravesh, M. M., and Dau, G. J., "Requalification of NDE Personnel for BWR IGSCC Detection," A Status Report to PVRC Subcom. on NDE of Pressure Components, Jan. 28, 1986, Available from PVRC, 345 E. 47th St., New York, NY 10017.
- Beyer (1966) Beyer, W. H., ed., CRC Handbook of Tables for Probability and Statistics. Cleveland, OH: Chemical Rubber Co. (1966).
- Buchanan (1976) Buchanan, R. A., "Analysis of the NDE of PVRC Plate-Weld Specimen 251J," WRC Bulletin 221, Nov. 1976. New York, NY: Welding Research Council (1976).
- Crump (1946) Crump, S. L., "The Estimation of Variance Components in Analysis of Variance," Biometrics Bulletin, Vol. 2, pp. 7-11 (1946).
- Daniels (1939) Daniels, H. E., "The estimation of components of variance," J. Roy. Stat. Soc., Supp., Vol. 6, pp. 186-197 (1939).
- Draper and Smith (1981) Draper, N. E., and Smith, H., Applied Regression Analysis, Second Edition. Wiley (1981).
- Eisenhart (1947) Eisenhart, C., "The Assumptions Underlying the Analysis of Variance," Biometrics, Vol. 3, No. 1, pp. 1-21 (1947).
- Filliben (1969) Filliben, J. J., "Simple and Robust Linear Estimation of the Location Parameter of a Symmetric Distribution," Ph.D. dissertation, Princeton University (1969).
- Filliben (1984) Filliben, J. J., DATAPLOT - Introduction and Overview, A special publication of the National Bureau of Standards, SP667, 119pp. Washington, DC: Gov't Printing Off. (1984).
- Filliben and Fong (1984) Filliben, J. J., and Fong, J. T., "DATAPLOT as an Expert System for Interactive Data Analysis," Proc. Symp. on Engineering Databases: Software for On-Line Applications, ASME Spec. Pub. PVP-96, pp. 37-55. New York, NY: Am. Soc. of Mech. Engineers (1984).

- Fong (1978) Fong, J. T., "Uncertainties in Fatigue Life Prediction and a Rational Definition of Safety Factors," Nuclear Eng. and Design, Vol. 51, pp. 45-54 (1978).
- Fong (1982) Fong, J. T., "A 3-dimensional Computer-Aided Graphical Representation of the Sectioning Data of Flaw A in PVRC Plate-Weld Specimen 251J," Report to PVRC Subcommittee on NDE of Pressure Components, Sep. 28, 1982. Available from PVRC, 345 East 47th Street, New York, NY (1982).
- Fong (1986a) Fong, J. T., "Integration of Analysis and Databases for Engineering Decision Making," to appear in CIME (Computers in Mechanical Engineering), 6, No. 3, May 1986.
- Fong (1986b) Fong, J. T., "Analysis of Sectioning Data of PVRC 251J for Estimating Flaw Fabrication Reliability," to appear in Proc. June 1983 Symp. on NDE Reliability Through Round Robin Testing, ASME Spec. Pub. NDE-1. New York, NY: Am. Soc. of Mechanical Engineers (1986).
- Fong, Cramer, & Redmiles (1984) Fong, J. T., Cramer, R. S., and Redmiles, D. F., "DATAx: A Prototype Software for Engineering Data Evaluation and Decision Support (Extended Abstract)," Proc. ASME Symp. on Engineering Databases: Software for On-Line Applications, San Antonio, June 1984, ASME Spec. Pub. PVP-96, pp. 115-118. New York, NY: Am. Soc. Mech. Engrs. (1984).
- Fong and Dowling (1981) Fong, J. T., and Dowling, N. E., "Analysis of Fatigue Crack Growth Rate Data from Different Laboratories," Fatigue Crack Growth Measurement and Data Analysis, ASTM STP 738, S. J. Hudak, Jr., and R. J. Bucci, eds., pp. 171-193. Philadelphia, PA: Am. Soc. f. Test. & Matls. (1981).
- Fong and Filliben (1986) Fong, J. T., and Filliben, J. J., "A Data Analysis Methodology for Estimating NDE Reliability from Round Robin Ultrasonic Testing Data," to appear in Proc. June 1983 Portland Symp. on NDE Reliability through Round Robin Testing, ASME Special Publication NDE-1. New York, NY: Am. Soc. of Mech. Engineers (1986).
- Gillette and Smedley (1968) Gillette, C. L., and Smedley, W. C., "Ultrasonic Examination of Weld Seams in PVRC Test Blocks Welded at Chattanooga," Combustion Engineering Report E-7322 to PVRC, Oct. 14, 1968 (Ref. SCPVS-68-252). Available from PVRC, 345 East 47th Street, New York, NY 10017.
- Hedden (1981) Hedden, O. F., PVRC Intercommittee Correspondence to J. T. Fong, March 16, 1981.



Hedden (1984a) Hedden, O. F., PVRC Intercommittee Correspondence to J. T. Fong, Feb. 17, 1984.

Hedden (1984b) Hedden, O. F., PVRC Intercommittee Correspondence to J. T. Fong, March 7, 1984.

Hedden (1985) Hedden, O. F., PVRC Intercommittee Correspondence to J. T. Fong, Oct. 28, 1985.

Hendricks (1951) Hendricks, W. A. "Variance Components as a tool for the Analysis of Sample Data," Biometrics, Vol. 7, No. 1, pp. 97-101 (1951).

Johnson, Toomay, and Davis (1979) Johnson, D. P., Toomay, T. L., and Davis, C. S., "Estimation of the Defect Detection Probability for Ultrasonic Tests on Thick Section Steel Weldments," EPRI NP-991 Project 700-1 Technical Report, Feb. 1979. Palo Alto, CA: Electric Power Research Institute (1979).

Joiner and Rosenblatt (1971) Joiner, B. L., and Rosenblatt, J. R., "Some Properties of the Range in Samples from Tukey's Symmetric Lambda Distributions," J. Am. Stat. Assoc., Vol. 66, No. 334, pp. 394-399 (1971).

Lewis, Sproat, Dodd, and Hamilton (1978) Lewis, W. H., Sproat, W. H., Dodd, B. D., and Hamilton, J. M., "Reliability of Nondestructive Inspections - Final Report," Lockheed-Georgia Report No. SA-ALC/MME 76-6-38-1 for Air Force Contract No. F41608-76-D-A005 Covering Period from July 1974 to Dec. 1978. Kelly AFB, TX: San Antonio Air Logistics Center (1978).

Mandel (1971) Mandel, J., "Repeatability and Reproducibility," Materials Research and Standards, Vol. 11, No. 8, pp. 8-16 (1971).

Mandel (1977) Mandel, J., "The Analysis of Interlaboratory Test Data," ASTM Standardization News, Vol. 5, No. 3, pp. 17-20 (1977).

PISC-I (1979a) "Destructive Examination of the PVRC plates Nos. 50-52, 51-53, & 204," EUR - 6371, Vol. III, published by the Commission of European Communities. Luxembourg: Office for Official Publications of the European Communities (1979).

PISC-I (1979b) "Analysis Scheme of the PISC trials results," EUR - 6371, Vol. IV, published by the Commission of European Communities. Luxembourg: Office for Official Publications of the European Communities (1979).

PISC-II (1985) "First Evaluation of the PISC-II Trials Results," PISC-II Report No. 5, June 1985. Luxembourg: Office for Official Publications of the European Communities (1985).

- Proschan (1953) Proschan, F., "Confidence and Tolerance Intervals for the Normal Distribution," J. Am. Stat. Assoc., Vol. 48, pp. 550-564 (1953).
- Ruescher and Graber (1980) Ruescher, E. H., and Graber, H. C., "Analysis of the Radiographic Evaluation of PVRC Weld Specimens 155, 202, 203, and 251J," WRC Bulletin 259, June 1980.
- Saiga (1983) Saiga, Y., "Sectioning of PVRC Test Plate 202," Japan PVRC Rep. to U.S. PVRC Subcom. on NDE of Press. Comp., Oct. 12, 1983. Available from PVRC, 345 E 47 St., NY, NY (1983).
- Saiga (1984a) Saiga, Y., "Analysis of the Ultrasonic Examinations of PVRC Weld Specimen 202," Japan PVRC Draft Rep. to U.S. PVRC Subcom. on NDE of Press. Comp., Jan. 23, 1984. PVRC (1984).
- Saiga (1984b) Saiga, Y., "Sectioning of PVRC Specimen 203," Japan PVRC Rep. to U.S. PVRC Subcom. on NDE of Press. Comp., May 23, 1984. Available from PVRC, New York, NY (1984).
- Saiga (1984c) Saiga, Y., "Analysis of the Ultrasonic Examinations of PVRC Weld Specimen 203," Japan PVRC Draft Rep. to U.S. PVRC Subcom. on NDE of Press. Comp., May 23, 1984. PVRC (1984).
- Watkins, Ervine, and Cowburn (1982) Watkins, B., Ervine, R. W., and Cowburn, K. J., "The UKAEA Defect Detection Trials (DDT)," Presented at the UKAEA DDT Symposium, Birchwood, Warrington, 7-8 Oct. 1982. Available from UKAEA Risley Nuclear Laboratories, Risley, Warrington, U.K. (1982).
- White (1968) White, J. K., "Inspection of Weld Specimens at Combustion Engineering, July 8, 9, & 10, 1968," Westinghouse Res. Lab. Progress Report to PVRC, Sep. 27, 1968 (Ref. SCPVS-668-105). Available from PVRC, 345 E. 47th St., New York, NY 10017.
- Yukawa (1981) Yukawa, S., "Sectioning Data of PVRC Plate-Weld Specimen 251J," Prog. Rep. to PVRC Subcom. on NDE of Pres. Comp., Jan. 15, 1981. Avail. from PVRC, 345 E 47 St., New York.
- Yukawa (1983) Yukawa, S., "Sectioning of PVRC NDE Specimen 251J," Progress Report to PVRC Subcom. on NDE of Pressure Comp., May 25, 1983. Available from PVRC, 345 E. 47 St., New York (1983).
- Yukawa (1984) Yukawa, S., "Sectioning Data of PVRC Plate-Weld Specimen 251J," Prog. Rep. to PVRC Subcom. on NDE of Pres. Comp., May 23, 1984. Avail. from PVRC, 345 E 47 St., New York.
- Yukawa (1986) Yukawa, S., "Sectioning Results for PVRC Plate Weld Specimen 251J," to appear in Proc. June 1983 Portland Symp. on NDE Reliability Through Round Robin Testing, ASME Spec. Pub. NDE-1. New York, NY: Am. Soc. of Mech. Engineers (1986).

## LIST OF TABLES

- Table 1    -    List of PVRC Weld Specimens for A Series of Round Robin Flaw Detection Program using Ultrasonic Testing (1966- ).
  
- Table 2    -    Intended Location Coordinates of 15 Flaws Implanted in PVRC Specimen 251J (LC = Longitudinal Crack; CC = Cross Crack; LS = Long Slag; and SS = Short Slag). After Buchanan (1976).
  
- Table 3    -    Actual Location Coordinates of 15 Flaws in PVRC Specimen 251J as determined by Sectioning (Yukawa, 1984). (LC = Longitudinal Crack; CC = Cross Crack; LS = Long Slag; and SS = Short Slag.)
  
- Table 4    -    Tolerance Factors K for Normal Distributions of Data of Sample Size N and for 90% Confidence that at least P % of the Population will be included in the interval  $(M - KS)$  and  $(M + KS)$ , where M = estimated mean, and S = est. s.d. After Beyer (1966).
  
- Table 5    -    Tolerance Factors K for Normal Distributions of Data of Sample Size N and for 95% Confidence that at least P % of the Population will be included in the interval  $(M - KS)$  and  $(M + KS)$ , where M = estimated mean, and S = est. s.d. After Beyer (1966).
  
- Table 6    -    Tolerance Factors K for Normal Distributions of Data of Sample Size N and for 99% Confidence that at least P % of the Population will be included in the interval  $(M - KS)$  and  $(M + KS)$ , where M = estimated mean, and S = est. s.d. After Beyer (1966).
  
- Table 7    -    Location Coordinates and Maximum DAC for 18 Indications of Flaws in PVRC Specimen 251J As Reported by Team A (1968 UT Procedure).
  
- Table 8    -    Location Coordinates and Maximum DAC for 4 Indications of Flaws in PVRC Specimen 251J As Reported by Team B (1968 UT Procedure).
  
- Table 9    -    Location Coordinates and Maximum DAC for 14 Indications of Flaws in PVRC Specimen 251J As Reported by Team C (1968 UT Procedure).
  
- Table 10   -    Location Coordinates and Maximum DAC for 6 Indications of Flaws in PVRC Specimen 251J As Reported by Team D (1968 UT Procedure).
  
- Table 11   -    Location Coordinates and Maximum DAC for 31 Indications of Flaws in PVRC Specimen 251J As Reported by Team F (1968 UT Procedure).
  
- Table 12   -    Team A (1968 Procedure) UT Data As Corrected by Hedden for PVRC Subcommittee on NDE of Pressure Components (Feb. 17, 1984).
  
- Table 13   -    Team A (1968 Procedure) UT Data As Corrected by Hedden for PVRC Subcommittee on NDE of Pressure Components (March 7, 1984).

Table 1 - List of PVRC Weld Specimens for A Series of Round Robin Flaw Detection Program using Ultrasonic Testing (1966- ).

Begin R:base 4000 Version 1.01 MSDOS Serial # #####  
 For the IBM Personal Computer  
 Copyright 1983 by Microrim, Inc.

For assistance type "HELP", for Prompt mode type "PROMPT"  
 R>  
 open a:pvrc  
 Database exists  
 listrel

Relations in the Database pvrc

platgeom weldgeom temp2 mat general temp1

listrel general

Relation: general  
 Read Password: NO  
 Modify Password: NO

	Attributes		
#	Name	Type	Length
1	specimen	TEXT	5 characters
2	fabrictr	TEXT	16 characters
3	thicknes	TEXT	16 characters
4	flawplan	TEXT	16 characters
5	sect'ner	TEXT	16 characters

Current number of rows: 12

select all from general

specimen	fabrictr	thicknes	flawplan	sect'ner
251-J	Combustion Eng.	11 in. (butt, s)	15 (var. types)	Yukawa (1984)
252-J	Combustion Eng.	8 in. (butt, e)	3 areas (var.)	---
253-J	Combustion Eng.	11 in. (f-nz, s)	20 (var. types)	---
254-J	Combustion Eng.	10 in. (f-nz, s)	25 (var. types)	---
201	Chicago B & I	8 in. (butt, m)	10 (var. types)	Adamonis (1979)
202	Chicago B & I	8 in. (butt, mc)	9 (var. types)	Saiga (1983)
203	Chicago B & I	8 in. (f-nz, m)	9 (var. types)	Saiga (1984b)
204	Chicago B & I	8 in. (f-nz, m)	9 (var. types)	PISC-I (1979)
50-52	Babcock & Wilcox	11 in. (butt, e)	gross cracks	PISC-I (1979)
51-53	Babcock & Wilcox	8 in. (butt, s)	gross cracks	PISC-I (1979)
155	Babcock & Wilcox	8.75" (f-nz, sc)	4 (all types)	---
156	Babcock & Wilcox	5 in. (c-nz, s)	3 areas (var.)	---

Legend:

c-nz = cast nozzle  
 e = electroslog weld  
 f-nz = forged nozzle  
 m = manual metal arc weld  
 mc = manual metal arc weld with cladding  
 s = submerged arc weld  
 sc = submerged arc weld with cladding



Table 2 - Intended Location Coordinates of 15 Flaws Implanted in PVRC Specimen 251J (LC = Longitudinal Crack; CC = Cross Crack; LS = Long Slag; and SS = Short Slag). After Buchanan (1976).

Begin R:base 4000 Version 1.01 MSDOS Serial # #####

For the IBM Personal Computer

Copyright 1983 by Microrim, Inc.

For assistance type "HELP", for Prompt mode type "PROMPT"

R>

open a:251-J

Database exists

listrel

Relations in the Database 251-J

sec-type	sec-ty-s	int-type	int-ty-s	sec-1-cc	sec-2-lc
int-15	sec-15	sec-3-ls	sec-4-ss	int-1-cc	int-2-lc
int-3-ls	int-4-ss				

listrel int-15

Relation: int-15

Read Password: NO

Modify Password: NO

Attributes				
#	Name	Type	Length	Key
1	flawname	TEXT	8 characters	
2	x1(int)	REAL	1 value(s)	
3	x2(int)	REAL	1 value(s)	
4	y1(int)	REAL	1 value(s)	
5	y2(int)	REAL	1 value(s)	
6	z1(int)	REAL	1 value(s)	
7	z2(int)	REAL	1 value(s)	

Current number of rows: 15

select all from int-15

	flawname	x1(int)	x2(int)	y1(int)	y2(int)	z1(int)	z2(int)
A	(CC)	25.5000	26.2500	2.98000	3.02000	0.98000	1.02000
B	(LS)	26.2300	26.2700	16.0000	18.0000	0.98000	1.02000
C	(LC)	26.2300	26.2700	30.0000	32.0000	0.98000	1.02000
D	(LC)	24.9800	25.0200	2.00000	4.00000	2.73000	2.77000
E	(CC)	25.0000	25.7500	16.9800	17.0200	2.73000	2.77000
F	(SS)	24.9800	25.0200	30.6500	31.4000	2.73000	2.77000
G	(LS)	26.2300	26.2700	2.00000	4.00000	5.48000	5.52000
H	(LC)	26.2300	26.2700	16.0000	18.0000	5.48000	5.52000
I	(CC)	25.5000	26.2500	30.9800	31.0200	5.48000	5.52000
J	(CC)	25.0000	25.7500	2.98000	3.02000	8.23000	8.27000
K	(SS)	25.0000	25.7500	16.9800	17.0200	8.23000	8.27000
L	(LC)	24.9800	25.0200	30.0000	32.0000	8.23000	8.27000
M	(LC)	26.2300	26.2700	2.00000	4.00000	9.98000	10.0200
N	(CC)	25.5000	26.2500	16.9800	17.0200	9.98000	10.0200
O	(LS)	26.2300	26.2700	30.0000	32.0000	9.98000	10.0200

Table 3 - Actual Location Coordinates of 15 Flaws in PVRC Specimen 251J as determined by Sectioning (Yukawa, 1984). (LC = Longitudinal Crack; CC = Cross Crack; LS = Long Slag; and SS = Short Slag.)

Begin R:base 4000 Version 1.01 MSDOS Serial # #####  
For the IBM Personal Computer  
Copyright 1983 by Microrim, Inc.

For assistance type "HELP", for Prompt mode type "PROMPT"

R>

open a:251-J

Database exists

listrel

Relations in the Database 251-J

sec-type	sec-ty-s	int-type	int-ty-s	sec-1-cc	sec-2-lc
int-15	sec-15	sec-3-ls	sec-4-ss	int-1-cc	int-2-lc
int-3-ls	int-4-ss				

listrel sec-15

Relation: sec-15  
Read Password: NO  
Modify Password: NO

Attributes			
#	Name	Type	Length
1	flawname	TEXT	8 characters
2	x1(sect)	REAL	1 value(s)
3	x2(sect)	REAL	1 value(s)
4	y1(sect)	REAL	1 value(s)
5	y2(sect)	REAL	1 value(s)
6	z1(sect)	REAL	1 value(s)
7	z2(sect)	REAL	1 value(s)

Current number of rows: 15

select all from sec-15

	flawname	x1(sect)	x2(sect)	y1(sect)	y2(sect)	z1(sect)	z2(sect)
A	(CC)	26.1000	26.4500	2.60000	4.20000	0.95000	1.30000
B	(LS)	26.3000	26.4500	16.1000	18.1000	0.60000	1.15000
C	(LC)	26.0000	26.4500	30.0500	33.2000	0.65000	1.20000
D	(LC)	25.1500	25.6500	2.20000	5.50000	2.35000	3.10000
E	(CC)	25.1500	25.4500	17.1000	19.1000	2.85000	3.15000
F	(SS)	25.1000	25.2500	30.7000	31.8000	1.90000	2.75000
G	(LS)	26.2000	26.4000	2.20000	4.80000	4.70000	5.45000
H	(LC)	25.6500	26.3500	16.1000	21.6000	4.95000	5.75000
I	(CC)	26.0000	26.3500	30.2000	32.0500	5.00000	5.65000
J	(CC)	25.1000	25.4500	3.05000	4.55000	7.70000	8.30000
K	(SS)	25.1000	25.4500	17.1500	18.1000	8.00000	8.25000
L	(LC)	25.1000	25.7500	29.1000	33.8500	7.60000	8.10000
M	(LC)	25.9500	26.3000	1.05000	5.45000	9.25000	9.85000
N	(CC)	25.3000	26.3000	16.8000	18.1000	9.35000	9.75000
O	(LS)	25.9500	26.2500	29.7500	32.2000	9.55000	10.3000



**Table 4** - Tolerance Factors K for Normal Distributions of Data of Sample Size N and for 90% Confidence that at least P % of the Population will be included in the interval  $(M - KS)$  and  $(M + KS)$ , where M = estimated mean, and S = est. s.d. After Beyer (1966).

Normal Distribution											
TOLERANCE FACTORS FOR NORMAL DISTRIBUTIONS											
$\lambda = 0.90$											
$N \backslash P$	0.75	0.90	0.95	0.99	0.999	$N \backslash P$	0.75	0.90	0.95	0.99	0.999
2	11.407	15.978	18.800	24.167	30.227	55	1.329	1.901	2.265	2.976	3.801
3	4.132	5.847	6.919	8.974	11.309	60	1.320	1.887	2.248	2.955	3.774
4	2.932	4.166	4.943	6.440	8.149	65	1.312	1.875	2.235	2.937	3.751
5	2.454	3.494	4.152	5.423	6.879	70	1.304	1.865	2.222	2.920	3.730
6	2.196	3.131	3.723	4.870	6.188	75	1.298	1.856	2.211	2.906	3.712
7	2.034	2.902	3.452	4.521	5.750	80	1.292	1.848	2.202	2.894	3.696
8	1.921	2.743	3.264	4.278	5.446	85	1.287	1.841	2.193	2.882	3.682
9	1.839	2.626	3.125	4.098	5.220	90	1.283	1.834	2.185	2.872	3.669
10	1.775	2.535	3.018	3.959	5.046	95	1.278	1.828	2.178	2.863	3.657
11	1.724	2.463	2.933	3.849	4.906	100	1.275	1.822	2.172	2.854	3.646
12	1.683	2.404	2.863	3.758	4.792	110	1.268	1.813	2.160	2.839	3.626
13	1.648	2.355	2.805	3.682	4.697	120	1.262	1.804	2.150	2.826	3.610
14	1.619	2.314	2.756	3.618	4.615	130	1.257	1.797	2.141	2.814	3.595
15	1.594	2.278	2.713	3.562	4.545	140	1.252	1.791	2.134	2.804	3.582
16	1.572	2.246	2.676	3.514	4.484	150	1.248	1.785	2.127	2.795	3.571
17	1.552	2.219	2.643	3.471	4.430	160	1.245	1.780	2.121	2.787	3.561
18	1.535	2.194	2.614	3.433	4.382	170	1.242	1.775	2.116	2.780	3.552
19	1.520	2.172	2.588	3.399	4.339	180	1.239	1.771	2.111	2.774	3.543
20	1.506	2.152	2.564	3.368	4.300	190	1.236	1.767	2.106	2.768	3.536
21	1.493	2.135	2.543	3.340	4.264	200	1.234	1.764	2.102	2.762	3.429
22	1.482	2.118	2.524	3.315	4.232	250	1.224	1.750	2.085	2.740	3.501
23	1.471	2.103	2.506	3.292	4.203	300	1.217	1.740	2.073	2.725	3.481
24	1.462	2.089	2.489	3.270	4.176	400	1.207	1.726	2.057	2.703	3.453
25	1.453	2.077	2.474	3.251	4.151	500	1.201	1.717	2.046	2.689	3.434
26	1.444	2.065	2.460	3.232	4.127	600	1.196	1.710	2.038	2.678	3.421
27	1.437	2.054	2.447	3.215	4.106	700	1.192	1.705	2.032	2.670	3.411
30	1.417	2.025	2.413	3.170	4.049	800	1.189	1.701	2.027	2.663	3.402
35	1.390	1.988	2.368	3.112	3.974	900	1.187	1.697	2.023	2.658	3.396
40	1.370	1.959	2.334	3.066	3.917	1000	1.185	1.695	2.019	2.654	3.390
45	1.354	1.935	2.306	3.030	3.871	$\infty$	1.150	1.645	1.960	2.576	3.291
50	1.340	1.916	2.284	3.001	3.833						

Table 5 - Tolerance Factors K for Normal Distributions of Data of Sample Size N and for 95% Confidence that at least P % of the Population will be included in the interval (M - KS) and (M + KS), where M = estimated mean, and S = est. s.d. After Beyer (1966).

*Normal Distribution*

**TOLERANCE FACTORS FOR NORMAL DISTRIBUTIONS**

$\lambda = 0.95$											
$\begin{matrix} P \\ N \end{matrix}$	0.75	0.90	0.95	0.99	0.999	$\begin{matrix} P \\ N \end{matrix}$	0.75	0.90	0.95	0.99	0.999
2	22.858	32.019	37.674	48.430	60.573	55	1.382	1.976	2.354	3.094	3.951
3	5.922	8.380	9.916	12.861	16.208	60	1.369	1.958	2.333	3.066	3.916
4	3.779	5.369	6.370	8.299	10.502	65	1.359	1.943	2.315	3.042	3.886
5	3.002	4.275	5.079	6.634	8.415	70	1.349	1.929	2.299	3.021	3.859
6	2.604	3.712	4.414	5.775	7.337	75	1.341	1.917	2.285	3.002	3.835
7	2.361	3.369	4.007	5.248	6.676	80	1.334	1.907	2.272	2.986	3.814
8	2.197	3.136	3.732	4.891	6.226	85	1.327	1.897	2.261	2.971	3.795
9	2.078	2.967	3.532	4.631	5.899	90	1.321	1.889	2.251	2.958	3.778
10	1.987	2.839	3.379	4.433	5.649	95	1.315	1.881	2.241	2.945	3.763
11	1.916	2.737	3.259	4.277	5.452	100	1.311	1.874	2.233	2.934	3.748
12	1.858	2.655	3.162	4.150	5.291	110	1.302	1.861	2.218	2.915	3.723
13	1.810	2.587	3.081	4.044	5.158	120	1.294	1.850	2.205	2.898	3.702
14	1.770	2.529	3.012	3.955	5.045	130	1.288	1.841	2.194	2.883	3.683
15	1.735	2.480	2.954	3.878	4.949	140	1.282	1.833	2.184	2.870	3.666
16	1.705	2.437	2.903	3.812	4.865	150	1.277	1.825	2.175	2.859	3.652
17	1.679	2.400	2.858	3.754	4.791	160	1.272	1.819	2.167	2.848	3.638
18	1.655	2.366	2.819	3.702	4.725	170	1.268	1.813	2.160	2.839	3.627
19	1.635	2.337	2.784	3.656	4.667	180	1.264	1.808	2.154	2.831	3.616
20	1.616	2.310	2.752	3.615	4.614	190	1.261	1.803	2.148	2.823	3.606
21	1.599	2.286	2.723	3.577	4.567	200	1.258	1.798	2.143	2.816	3.597
22	1.584	2.264	2.697	3.543	4.523	250	1.245	1.780	2.121	2.788	3.561
23	1.570	2.244	2.673	3.512	4.484	300	1.236	1.767	2.106	2.767	3.535
24	1.557	2.225	2.651	3.483	4.447	400	1.223	1.749	2.084	2.739	3.499
25	1.545	2.208	2.631	3.457	4.413	500	1.215	1.737	2.070	2.721	3.475
26	1.534	2.193	2.612	3.432	4.382	600	1.209	1.729	2.060	2.707	3.458
27	1.523	2.178	2.595	3.409	4.353	700	1.204	1.722	2.052	2.697	3.445
30	1.497	2.140	2.549	3.350	4.278	800	1.201	1.717	2.046	2.688	3.434
35	1.462	2.090	2.490	3.272	4.179	900	1.198	1.712	2.040	2.682	3.426
40	1.435	2.052	2.445	3.213	4.104	1000	1.195	1.709	2.036	2.676	3.418
45	1.414	2.021	2.408	3.165	4.042	$\infty$	1.150	1.645	1.960	2.576	3.291
50	1.396	1.996	2.379	3.126	3.993						

**Table 6** - Tolerance Factors K for Normal Distributions of Data of Sample Size N and for 99% Confidence that at least P % of the Population will be included in the interval (M - KS) and (M + KS), where M = estimated mean, and S = est. s.d. After Beyer (1966).

Normal Distribution											
TOLERANCE FACTORS FOR NORMAL DISTRIBUTIONS											
$\lambda = 0.99$											
$\frac{P}{N}$	0.75	0.90	0.95	0.99	0.999	$\frac{P}{N}$	0.75	0.90	0.95	0.99	0.999
2	114.363	160.193	188.491	242.300	303.054	55	1.490	2.130	2.538	3.335	4.260
3	13.378	18.930	22.401	29.055	36.616	60	1.471	2.103	2.506	3.293	4.206
4	6.614	9.398	11.150	14.527	18.383	65	1.455	2.080	2.478	3.257	4.160
5	4.643	6.612	7.855	10.260	13.015	70	1.440	2.060	2.454	3.225	4.120
6	3.743	5.337	6.345	8.301	10.548	75	1.428	2.042	2.433	3.197	4.084
7	3.233	4.613	5.488	7.187	9.142	80	1.417	2.026	2.414	3.173	4.053
8	2.905	4.147	4.936	6.468	8.234	85	1.407	2.012	2.397	3.150	4.024
9	2.677	3.822	4.550	5.966	7.600	90	1.398	1.999	2.382	3.130	3.999
10	2.508	3.582	4.265	5.594	7.129	95	1.390	1.987	2.368	3.112	3.976
11	2.378	3.397	4.045	5.308	6.766	100	1.383	1.977	2.355	3.096	3.954
12	2.274	3.250	3.870	5.079	6.477	110	1.369	1.953	2.333	3.066	3.917
13	2.190	3.130	3.727	4.893	6.240	120	1.358	1.942	2.314	3.041	3.885
14	2.120	3.029	3.608	4.737	6.043	130	1.349	1.928	2.298	3.019	3.857
15	2.060	2.945	3.507	4.605	5.876	140	1.340	1.916	2.283	3.000	3.833
16	2.009	2.872	3.421	4.492	5.732	150	1.332	1.905	2.270	2.983	3.811
17	1.965	2.808	3.345	4.393	5.607	160	1.326	1.896	2.259	2.968	3.792
18	1.926	2.753	3.279	4.307	5.497	170	1.320	1.887	2.248	2.955	3.774
19	1.891	2.703	3.221	4.230	5.399	180	1.314	1.879	2.239	2.942	3.759
20	1.860	2.659	3.168	4.161	5.312	190	1.309	1.872	2.230	2.931	3.744
21	1.833	2.620	3.121	4.100	5.234	200	1.304	1.865	2.222	2.921	3.731
22	1.808	2.584	3.078	4.044	5.163	250	1.286	1.839	2.191	2.880	3.678
23	1.785	2.551	3.040	3.993	5.098	300	1.273	1.820	2.169	2.850	3.641
24	1.764	2.522	3.004	3.947	5.039	400	1.255	1.794	2.138	2.809	3.589
25	1.745	2.494	2.972	3.904	4.985	500	1.243	1.777	2.117	2.783	3.555
26	1.727	2.469	2.941	3.865	4.935	600	1.234	1.764	2.102	2.763	3.530
27	1.711	2.446	2.914	3.825	4.888	700	1.227	1.755	2.091	2.748	3.511
30	1.668	2.385	2.841	3.733	4.768	800	1.222	1.747	2.082	2.736	3.495
35	1.613	2.306	2.748	3.611	4.611	900	1.218	1.741	2.075	2.726	3.483
40	1.571	2.247	2.677	3.518	4.493	1000	1.214	1.736	2.068	2.718	3.472
45	1.539	2.200	2.621	3.444	4.399	$\infty$	1.150	1.645	1.960	2.576	3.291
50	1.512	2.162	2.576	3.385	4.323						

Table 7 - Location Coordinates and Maximum DAC for 18 Indications of Flaws in PVRC Specimen 251J As Reported by Team A (1968 UT Procedure).

Team A (1968 Procedure) UT Data (Uncorrected)

*File Name: [PVRC] UT68A.DAT*

<u>INDICA:</u>	<u>DACMAX.</u>	<u>X1UTA</u>	<u>X2UTA</u>	<u>Y1UTA</u>	<u>Y2UTA</u>	<u>Z1UTA</u>	<u>Z2UTA</u>	<u>UT68A.DAT</u>
1	50	25.79	25.81	32.10	33.10	7.99	8.01	
2	30	27.99	28.01	27.60	30.60	10.99	11.01	
3	50	27.59	27.61	27.60	30.60	12.99	13.01	
4	50	27.49	27.51	27.60	30.60	17.49	17.51	
5	30	28.59	28.61	12.30	17.30	5.49	5.51	
6	100	26.59	26.61	16.40	17.40	7.74	7.76	
7	50	27.99	28.01	13.40	17.40	14.99	15.01	
8	110	28.59	28.61	0.34	2.34	8.94	8.96	
9	50	27.19	27.21	1.35	2.59	16.99	17.01	
10	25	26.99	27.01	3.75	5.25	2.94	2.96	
11	40	27.99	28.01	0.44	1.94	4.99	5.01	
12	110	26.79	26.81	1.19	3.69	3.04	3.06	
13	80	26.99	27.01	2.25	3.75	9.04	9.06	
14	120	26.49	26.51	1.44	3.44	14.99	15.01	
15	100	27.79	27.81	13.20	16.00	19.99	20.01	
16	60	27.19	27.21	14.45	18.95	4.99	5.01	
17	50	26.49	26.51	16.70	17.70	14.74	14.76	
18	200	25.79	25.81	27.00	30.00	9.99	10.01	

Table 8    -    Location Coordinates and Maximum DAC for 4 Indications of Flaws  
in PVRC Specimen 251J As Reported by Team B (1968 UT Procedure).

Team B (1968 Procedure) UT Data (Uncorrected)

*File Name: [PVRC] UT68B.DAT*

<u>INDICA.</u>	<u>DACMAX.</u>	<u>X1UTB</u>	<u>X2UTB</u>	<u>Y1UTB</u>	<u>Y2UTB</u>	<u>Z1UTB</u>	<u>Z2UTB</u>	<u>UT68B.DAT</u>
1	25	25.20	25.70	2.00	6.00	5.50	6.60	
2	30	25.20	25.70	16.00	13.50	9.00	9.50	
3	25	26.30	26.70	16.30	22.30	6.50	7.00	
4	30	26.30	26.60	28.30	32.20	9.00	9.50	

\$

Table 9 - Location Coordinates and Maximum DAC for 14 Indications of Flaws in PVRC Specimen 251J As Reported by Team C (1968 UT Procedure).

Team C (1968 Procedure) UT Data (Uncorrected)

*File Name: [PVRC] UT68C.DAT*

<u>INDICA.</u>	<u>DACMAX.</u>	<u>X1UTC</u>	<u>X2UTC</u>	<u>Y1UTC</u>	<u>Y2UTC</u>	<u>Z1UTC</u>	<u>Z2UTC</u>	<u>UT68C.DAT</u>
1	100	24.98	25.02	15.50	18.50	0.98	1.02	
2	40	24.98	25.02	30.50	33.75	5.48	5.52	
3	75	24.98	25.02	1.00	4.50	9.98	10.02	
4	40	25.98	26.02	1.75	2.50	2.73	2.77	
5	60	25.98	26.02	16.00	21.00	3.23	3.27	
6	25	24.98	25.02	1.50	4.50	0.98	1.02	
7	40	26.48	26.52	30.00	34.25	2.73	2.77	
8	40	25.48	25.52	14.50	20.00	5.48	5.52	
9	45	25.98	26.02	1.00	6.00	3.23	3.27	
10	75	24.98	25.02	30.00	34.00	9.98	10.02	
11	11	25.98	26.02	31.98	32.02	0.98	1.02	
12	9	25.98	26.02	16.98	17.02	2.73	2.77	
13	8	25.98	26.02	1.98	2.02	5.48	5.52	
14	9	25.98	26.02	16.98	17.02	9.98	10.02	



Table 10 - Location Coordinates and Maximum DAC for 6 Indications of Flaws in PVRC Specimen 251J As Reported by Team D (1968 UT Procedure).

Team D (1968 Procedure) UT Data (Uncorrected)

*File Name: [PVRC] UT68D.DAT*

<u>INDICA.</u>	<u>DACMAX.</u>	<u>X1UTD</u>	<u>X2UTD</u>	<u>Y1UTD</u>	<u>Y2UTD</u>	<u>Z1UTD</u>	<u>Z2UTD</u>	<u>UT68D.DAT</u>
1	100	30.48	30.52	3.00	4.50	2.38	3.02	
2	100	33.92	33.96	17.00	20.00	5.48	5.52	
3	100	36.23	36.27	30.00	31.00	7.00	10.00	
4	70	14.11	14.15	30.50	34.00	8.00	11.00	
5	100	17.98	18.02	17.00	18.00	5.00	11.00	
6	100	12.38	12.42	1.75	3.50	8.98	9.02	

Table 11 - Location Coordinates and Maximum DAC for 31 Indications of Flaws in PVRC Specimen 251J As Reported by Team F (1968 UT Procedure).

Team F (1968 Procedure) UT Data (Uncorrected)

File Name: [PVRC] UT68F.DAT

INDICA.	DACMAX.	X1UTF	X2UTF	Y1UTF	Y2UTF	Z1UTF	Z2UTF	UT68F.DAT
1	41	25.50	25.75	32.50	31.37	7.50	8.37	
2	100	25.50	27.00	30.00	32.00	0.02	0.37	
3	60	24.48	24.52	31.35	31.39	1.48	1.52	
4	55	25.48	25.52	30.60	30.64	7.48	7.52	
5	62	24.35	24.39	30.73	30.77	0.02	0.04	
6	107	25.48	25.52	29.98	30.02	0.35	0.39	
7	38	25.98	26.02	29.23	29.27	10.35	10.39	
8	86	25.23	25.27	26.50	26.37	0.02	0.04	
9	71	25.48	25.52	21.85	21.89	0.02	0.04	
10	70	25.25	25.50	17.75	18.25	5.12	6.00	
11	38	26.73	26.77	17.23	17.27	10.35	10.39	
12	68	24.98	25.02	16.73	16.77	8.35	8.39	
13	38	25.50	25.75	16.25	16.75	5.12	6.12	
14	150	25.73	25.77	15.37	16.37	0.02	0.37	
15	57	26.48	26.52	10.98	11.02	0.02	0.04	
16	70	25.98	26.02	4.35	4.39	4.48	4.52	
17	200	26.48	26.52	2.48	2.52	5.35	5.39	
18	200	25.48	25.52	2.48	2.52	3.23	3.27	
19	93	25.75	27.25	1.75	3.00	9.25	10.75	
20	90	25.73	25.77	5.73	5.77	2.48	2.52	
21	57	25.48	25.52	5.73	5.77	0.02	0.04	
22	110	26.50	27.00	4.00	5.00	5.12	5.37	
23	150	25.50	26.00	4.50	6.00	2.75	3.50	
24	46	24.98	25.02	2.25	2.39	2.60	2.64	
25	57	27.48	27.52	13.48	13.52	0.10	0.14	
26	43	26.98	27.02	15.48	15.52	0.02	0.04	
27	200	26.75	27.50	17.00	18.50	0.02	2.37	
28	200	26.00	26.50	19.00	19.75	5.98	6.02	
29	43	24.98	25.02	28.23	28.27	0.02	0.04	
30	159	26.50	27.00	30.00	31.37	9.37	10.75	
31	73	26.23	26.27	23.73	23.77	6.23	6.27	

Table 12 - Team A (1968 Procedure) UT Data As Corrected by Hedden for PVRC Subcommittee on NDE of Pressure Components (Feb. 17, 1984).

Team A (1968 Proced.) UT Data (Hedden, 84-02-17)

*File Name:* [PVRC] UT68AX.DAT

<u>INDICA.</u>	<u>DACMAX.</u>	<u>X1UAX</u>	<u>X2UAX</u>	<u>Y1UAX</u>	<u>Y2UAX</u>	<u>Z1UAX</u>	<u>Z2UAX</u>	<u>UT68AX.</u>
1	50	24.79	24.81	32.10	33.10	7.99	8.01	
2	80	26.99	27.01	27.60	30.60	10.99	11.01	
3	50	26.59	26.61	27.60	30.60	8.99	9.01	
4	50	26.49	26.51	27.60	30.60	4.49	4.51	
5	80	27.59	27.61	12.30	17.30	5.49	5.51	
6	100	25.59	25.61	16.40	17.40	7.74	7.76	
7	50	26.99	27.01	13.40	17.40	6.99	7.01	
8	110	27.59	27.61	0.34	2.34	8.94	8.96	
9	50	26.19	26.21	1.35	2.59	5.04	5.06	
10	25	25.99	26.01	3.75	5.25	2.94	2.96	
11	40	26.99	27.01	0.44	1.94	4.94	4.96	
12	110	25.79	25.81	1.19	3.69	3.04	3.06	
13	80	25.99	26.01	2.25	3.75	9.04	9.06	
14	120	25.49	25.51	1.44	3.44	6.99	7.01	
15	100	26.79	26.81	13.20	16.00	1.99	2.01	
16	60	26.19	26.21	14.45	18.95	4.99	5.01	
17	50	25.49	25.51	16.70	17.70	7.19	7.21	
18	200	24.79	24.81	27.00	30.00	9.99	10.01	

\$

Table 13 - Team A (1968 Procedure) UT Data As Corrected by Hedden for PVRC Subcommittee on NDE of Pressure Components (March 7, 1984).

Team A (1968 Proced.) UT Data (Hedden, 84-03-07)

*File Name: [PVRC] UT68AY.DAT*

<u>INDICA.</u>	<u>DACMAX.</u>	<u>X1UAY</u>	<u>X2UAY</u>	<u>Y1UAY</u>	<u>Y2UAY</u>	<u>Z1UAY</u>	<u>Z2UAY</u>	<u>UT68AY.</u>
1	50	24.79	24.81	30.60	32.60	7.99	8.01	
2	80	25.59	25.61	28.95	31.95	9.35	10.45	
3	50	24.59	24.61	29.05	32.05	10.30	10.65	
4	50	26.49	26.51	29.00	32.00	4.49	4.51	
5	80	25.89	25.91	14.80	19.80	4.65	5.75	
6	100	25.79	25.81	16.30	17.30	8.29	8.31	
7	50	25.79	25.81	15.30	19.30	7.84	7.86	
8	110	26.59	26.61	1.50	4.00	8.14	8.16	
9	50	24.79	24.81	1.80	3.00	6.24	6.26	
10	25	25.59	25.61	4.30	5.80	3.00	3.60	
11	40	25.59	25.61	2.30	4.80	3.40	3.95	
12	110	25.59	25.61	1.80	3.30	3.00	4.05	
13	80	26.59	26.61	3.00	4.50	8.24	8.26	
14	120	24.79	24.81	2.30	4.30	6.34	6.36	
15	100	26.79	26.81	15.00	18.00	1.99	2.01	
16	60	25.89	25.91	16.20	20.50	4.75	5.35	
17	50	25.79	25.81	17.50	19.00	7.74	7.76	
18	200	24.60	25.60	28.50	31.50	9.45	10.55	



## LIST OF FIGURES

- Fig. 1      Dimensions of PVRC Specimen 251J. After Yukawa (1983).
- Fig. 2      Principal Sectioning Cuts. After Yukawa (1983).
- Fig. 3      Outline of Flaw A as Projected on the XY and YZ Planes. After Yukawa (1981).
- Fig. 4      A 3-Dimensional Computer-Aided Graphical Representation of Flaw A Based on its Projected Outline (Yukawa, 1981).
- Fig. 5      An Enlarged View of Flaw A As Reconstructed from XY and YZ projections with the assumption that any XZ section of the flaw is a straight line.
- Fig. 6      Elevation of PVRC 251J showing the actual locations of 15 flaws as characterized in Table 3. After Yukawa (1984).
- Fig. 7      Elevation and End View of Sub-Block 1 to show actual locations of 5 flaws (Yukawa, 1984).
- Fig. 8      Elevation and End View of Sub-Block 2 to show actual locations of 5 flaws (Yukawa, 1984).
- Fig. 9      Elevation and End View of Sub-Block 3 to show actual locations of 5 flaws (Yukawa, 1984).
- Fig. 10     Comparison of Intended (Solid Line) vs. Actual (Dotted Line) Locations of 15 Flaws as shown in the Elevation of the Entire Block 251J.
- Fig. 11     Histogram and Normal Distribution Plot for Normalized Maximum Flaw Dimension Data (Intended Maximum Dimension equals unity).

- Fig. 12      Probability Plot for Testing a Normal Distribution Fit for Flaw Size Amplification Data
- Fig. 13      Lambda Test for Symmetric Distribution Fit of Flaw Size Amplification Data. After Filliben (1969) and Joiner-Rosenblatt (1971).
- Fig. 14      Box Plot for 4 Different Types of Flaws to check suitability of introducing Analysis of Variance (ANOVA) for estimating between-type variability.
- Fig. 15      Normal Distribution Plots for Normalized Maximum Dimension Data with or without estimating the between-type variability.
- Fig. 16      Upper and Lower Limits for Mean Amplification of Intended Flaw Size for Confidence Levels between 50% and 95%.
- Fig. 17      Upper and Lower Limits for Variance of the Flaw Size Data for Confidence Levels between 50% and 95%.
- Fig. 18      Tolerance Factors (TF or K) for Sample Size N=15 and 3 population coverages (90%, 95%, & 99%), as interpolated from Tables 4,5, & 6 (Beyer, 1966).
- Fig. 19      Tolerance Factors (TF or K) for Sample Size N= 5 and 3 population coverages (90%, 95%, & 99%), as interpolated from Tables 4,5, & 6 (Beyer, 1966).
- Fig. 20      Reliability of Flaw Fabrication As Defined by the Upper Tolerance Limit Curves for 3 coverages with the inclusion of between-type variability.
- Fig. 21      Reliability of Longitudinal Crack Fabrication as Defined by the Upper Tolerance Limit Curves for 3 coverages.
- Fig. 22      Reliability of Cross Crack Fabrication as Defined by the Upper Tolerance Limit Curves for 3 coverages.
- Fig. 23      Reliability of Slag Fabrication as Defined by the Upper Tolerance Limit Curves for 3 coverages.
- Fig. 24      Elevation of PVRC 251J showing the locations of some or all of the indications reported by Team A (Ultrasonic Testing Data, Uncorrected).
- Fig. 25      Elevation of PVRC 251J showing the locations of some or all of the indications reported by Team B (Ultrasonic Testing Data, Uncorrected).

- Fig. 26      Elevation of PVRC 251J showing the locations of some or all of the indications reported by Team C (Ultrasonic Testing Data, Uncorrected).
- Fig. 27      Elevation of PVRC 251J showing the locations of some or all of the indications reported by Team D (Ultrasonic Testing Data, Uncorrected).
- Fig. 28      Elevation of PVRC 251J showing the locations of some or all of the indications reported by Team F (Ultrasonic Testing Data, Uncorrected).
- Fig. 29      Elevation of PVRC 251J showing the locations of some or all of the indications reported by Team A (UT Data, Corrected by Hedden, Feb. 17, 1984).
- Fig. 30      Elevation of PVRC 251J showing the locations of some or all of the indications reported by Team A (UT Data, Corrected by Hedden, Mar. 7, 1984).
- Fig. 31      Typical Result of an Automated Flaw Detection Analysis with a Variable Detection Threshold to Parametrize the Decision-Making Process.
- Fig. 32      A Special Case of Flaw Detection Analysis where a call for a unique detection is too sensitive to the choice of a detection threshold.
- Fig. 33      A Special Case of Flaw Detection Analysis where a call for a unique detection does not exist.
- Fig. 34      A Typical Case of Flaw Detection Analysis for all indications reported by Team B (Ultrasonic Testing Data, Uncorrected).
- Fig. 35      A Special Case of Flaw Detection Analysis for Indications Reported by Team C, where the size factor is extremely small.
- Fig. 36      A Special Case of Flaw Detection Analysis for Indications Reported by Team C, where the size factor is extremely Large.
- Fig. 37      A Problem Case of Flaw Detection Analysis for Indications Reported by Team D.
- Fig. 38      True-Call and Flaw Detection Probabilities for Individual Team A (UT Data, Corrected 84-03-07).
- Fig. 39      True-Call and Flaw Detection Probabilities for Individual Team B (UT Data, Uncorrected).

- Fig. 40 True-Call and Flaw Detection Probabilities for Individual Team C (UT Data, Uncorrected).
- Fig. 41 A Performance Measure of Team A for Detection of 3 Different Types of Flaws
- Fig. 42 A Performance Measure of Team B for Detection of 3 Different Types of Flaws
- Fig. 43 A Performance Measure of Team C for Detection of 3 Different Types of Flaws
- Fig. 44 Histogram of Detection Threshold for Combined 3-Team Detection Data for Reliability Modeling
- Fig. 45 Lambda Test for Symmetric Distribution Fit of the 3-Team Detection Threshold Data.
- Fig. 46 Probability Plot Correlation Coefficient vs. Weibull Shape Parameter for a Test of Unsymmetric Distribution Fit.
- Fig. 47 An Enlarged Plot of Fig. 47 near Shape Parameter Equal to 3.6 for which Weibull approaches the shape of a Normal Distribution.
- Fig. 48 Probability Plot Correlation Coefficient vs. Scale Parameter of Extreme Value Distribution as a Test for Unsymmetrical Distribution Fit.
- Fig. 49 Analysis of Variance (ANOVA) for Estimating Between-Team Effect on Detection for the 3-Team Threshold Data.
- Fig. 50 Analysis of Variance (ANOVA) for Estimating Flawtype Effect on Detection for the 3-Team Threshold Data.
- Fig. 51 Analysis of Variance (ANOVA) for Estimating DAC Effect on Detection for the 3-Team Threshold Data.
- Fig. 52 Tolerance Factors (TF or K) for Sample Size N=28 and 3 population coverages (90%, 95%, & 99%), as interpolated from Tables 4, 5, & 6 (Beyer, 1966).
- Fig. 53 Reliability of Ultrasonic Detection (1968 Procedure) of Weld Flaws As Defined by the Upper Tolerance Limit Curves for Threshold & 3 Coverages



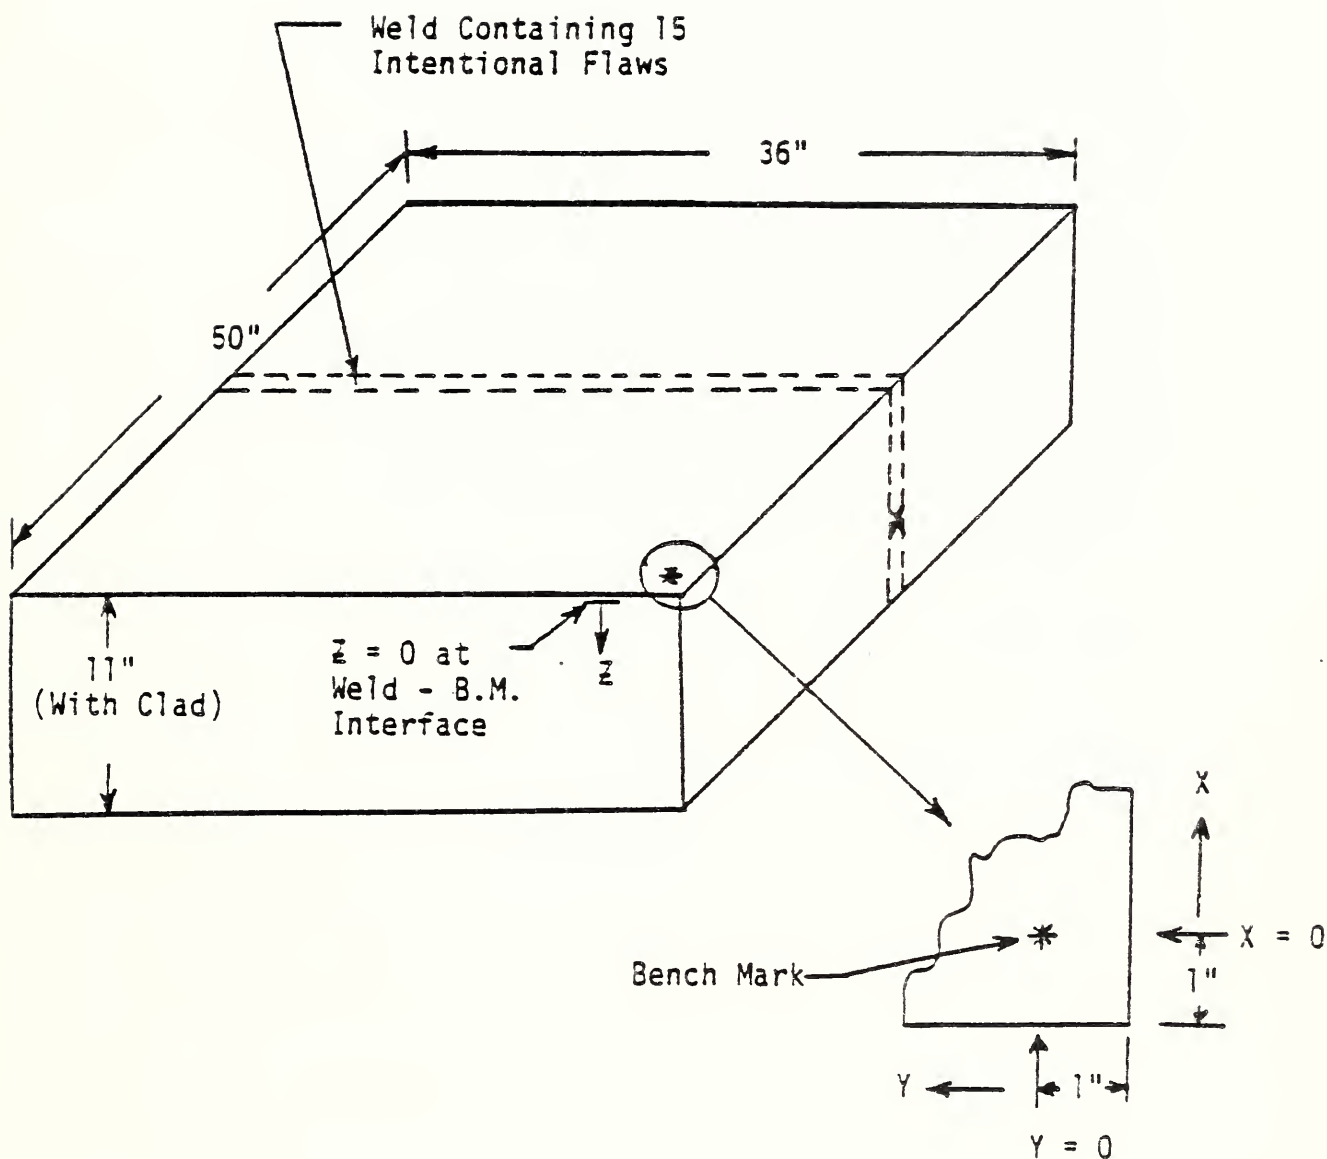


Fig. 1 Dimensions of PVRC Specimen 251J. After Yukawa (1983).

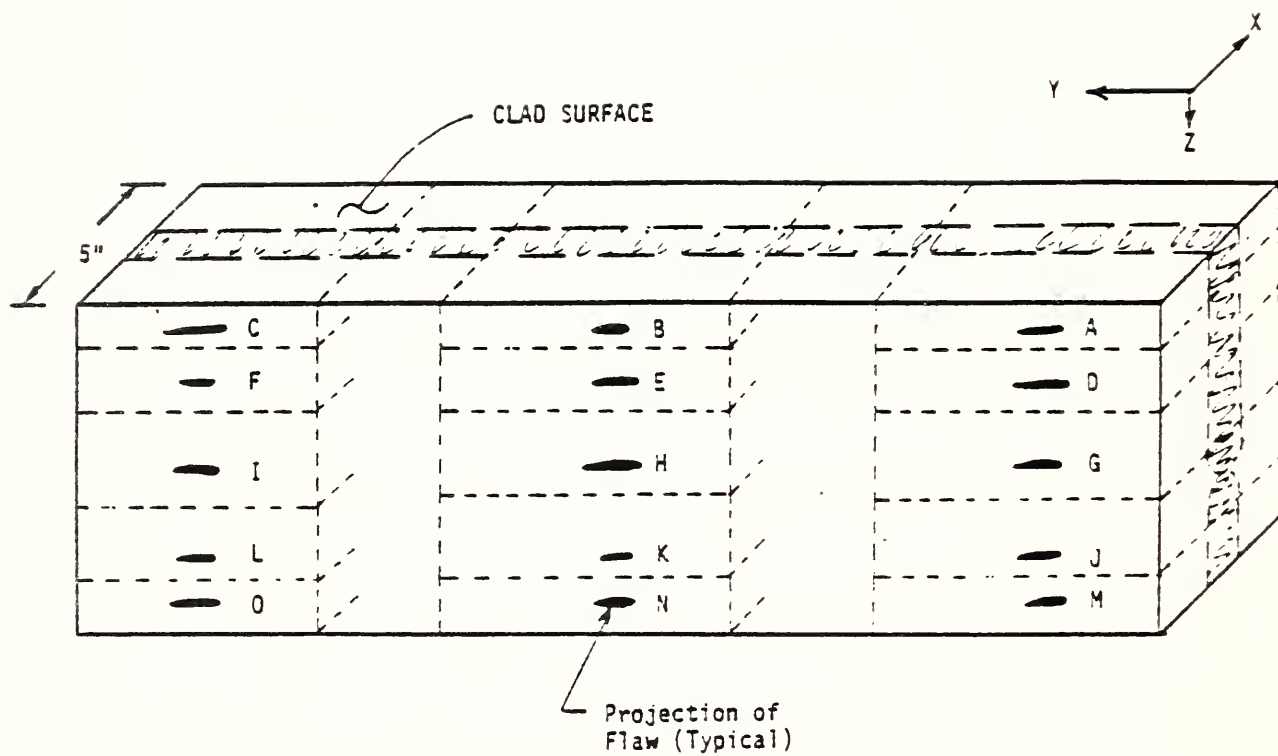


Fig. 2 Principal Sectioning Cuts. After Yukawa (1983).

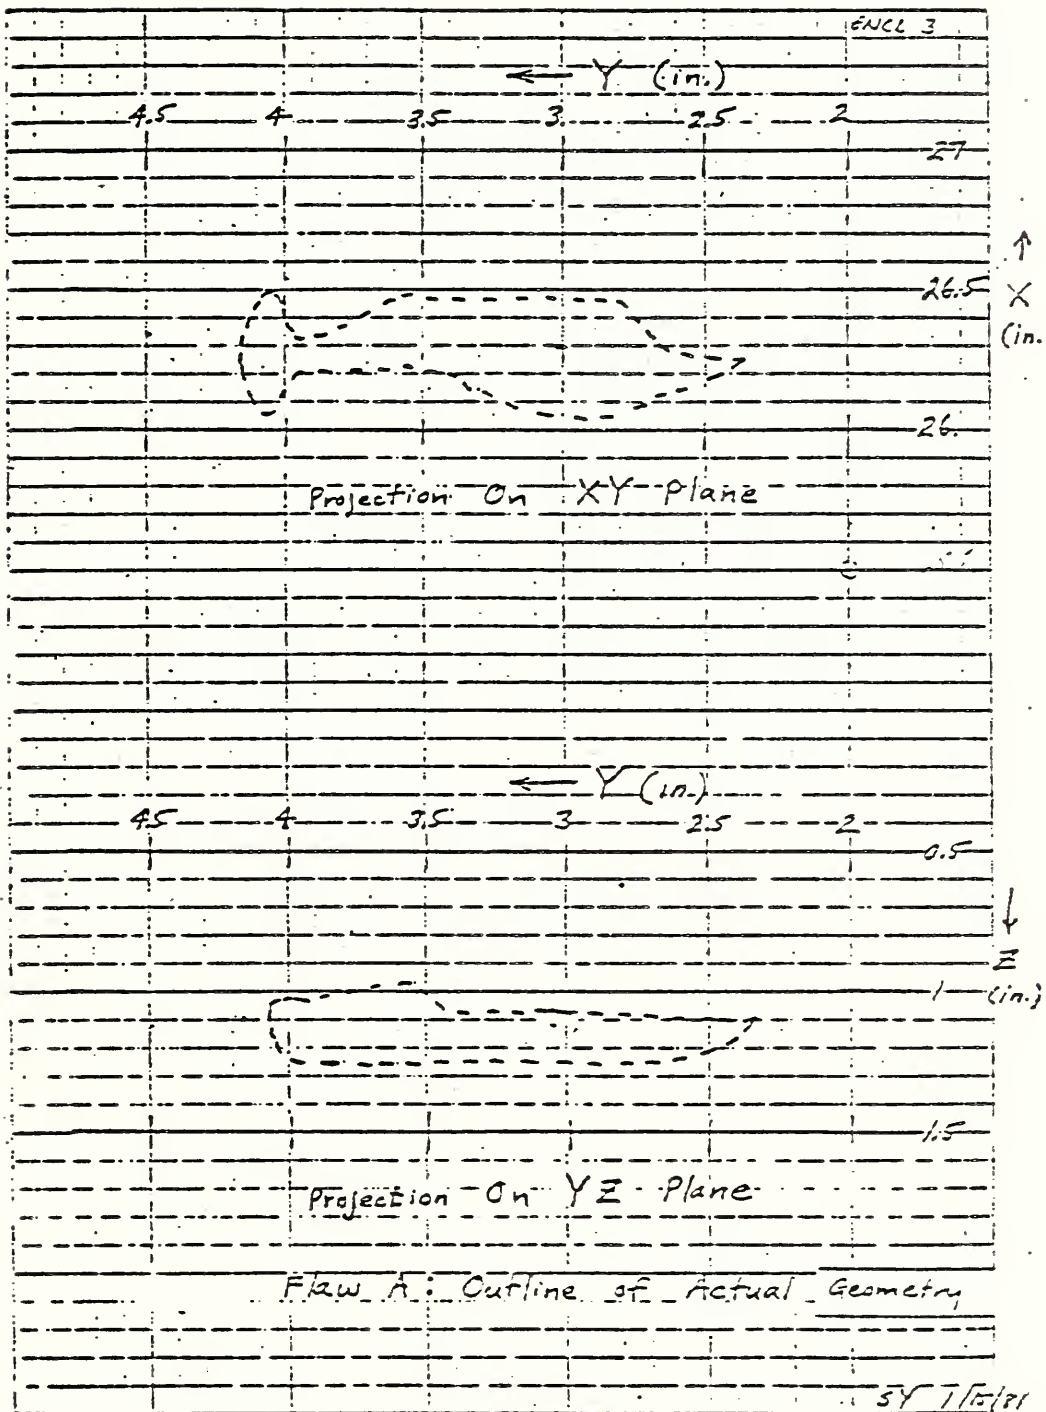


Fig. 3 Outline of Flaw A as Projected on the XY and YZ Planes. After Yukawa (1981).

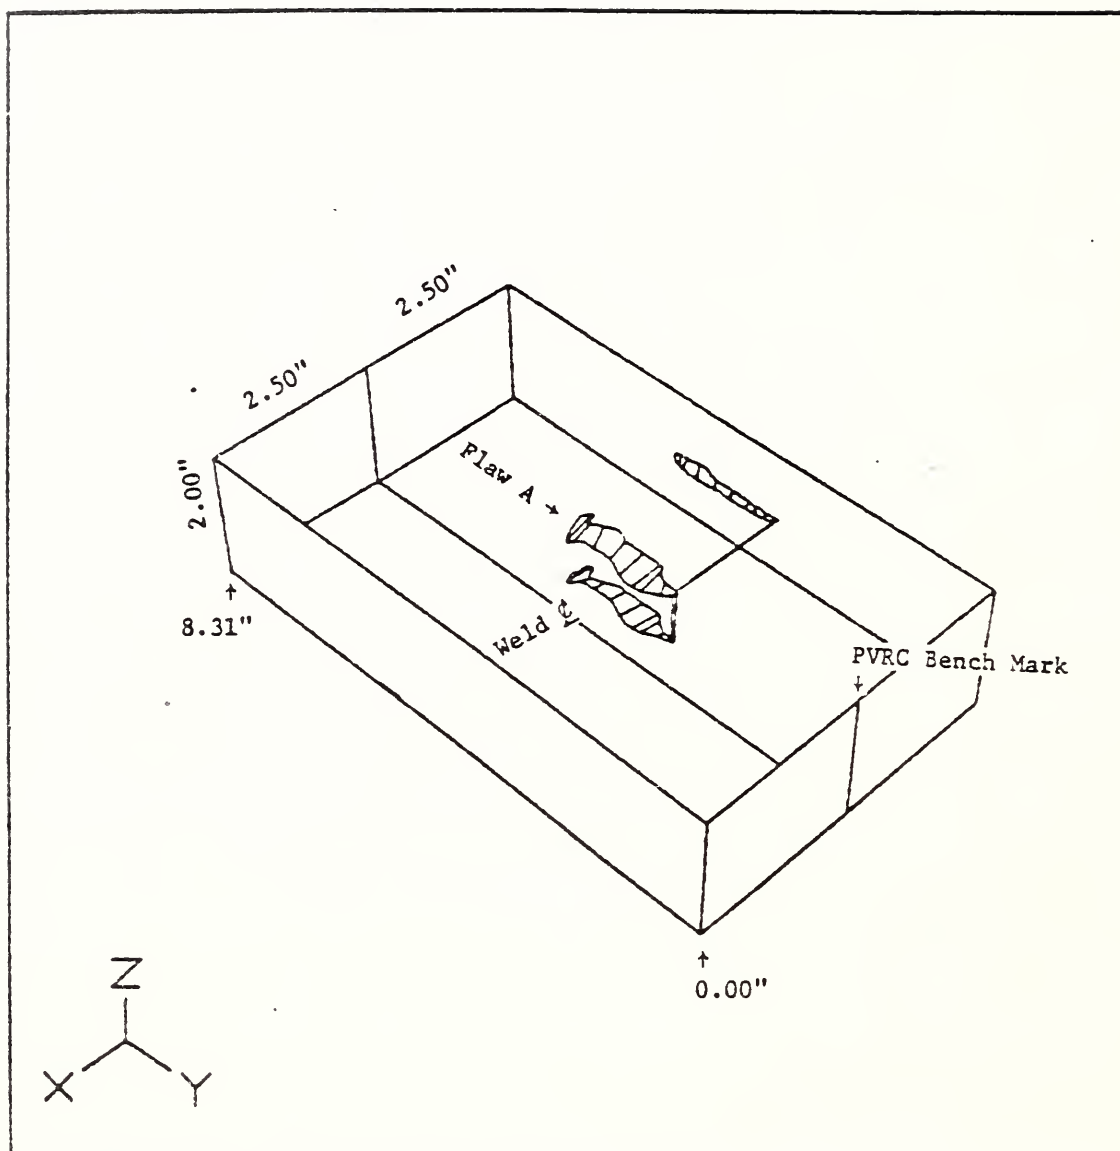


Fig. 4

A 3-Dimensional Computer-Aided Graphical Representation of Flaw A Based on its Projected Outline (Yukawa, 1981).




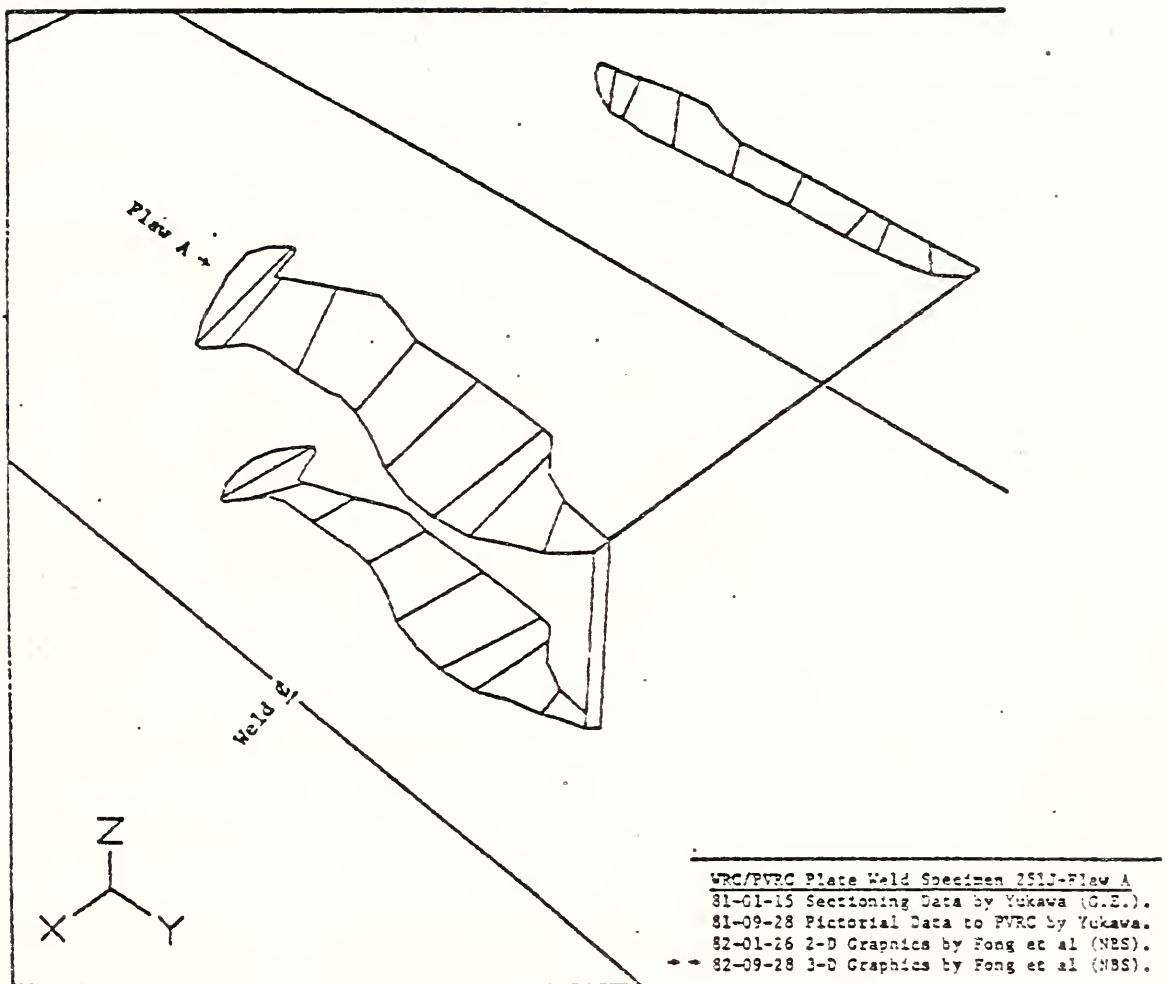


Fig. 5 An Enlarged View of Flaw A As Reconstructed from XY and YZ projections with the assumption that any XZ section of the flaw is a straight line.

PVRC 251J: ACTUAL FLAW LOCATIONS (YUKAWA, 84-03-22)

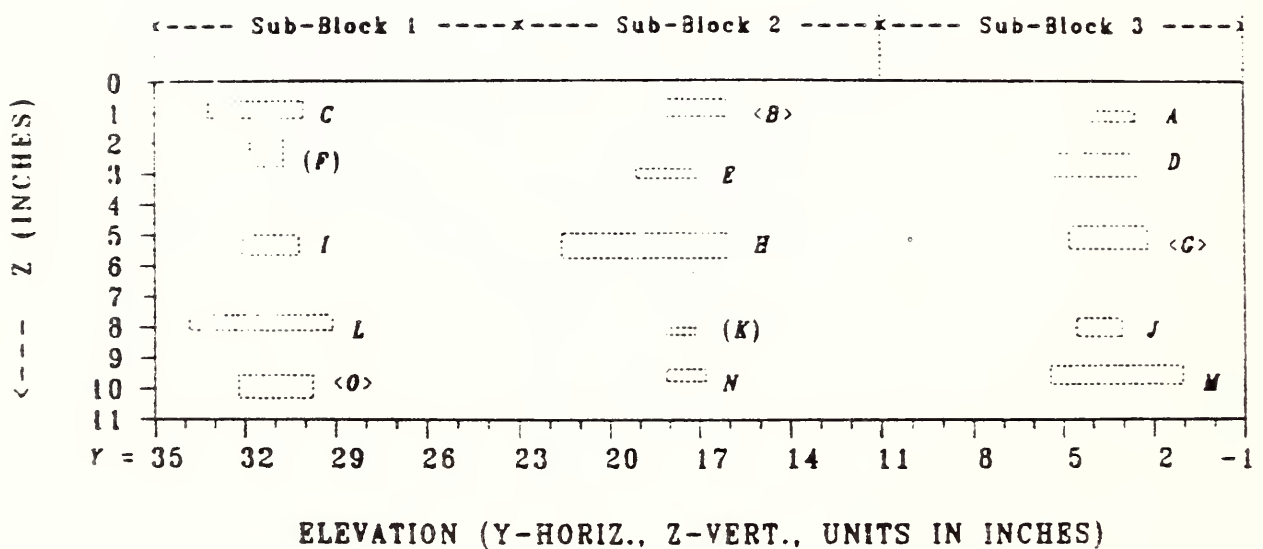


A,E,I,J,N are cross cracks (CC). C,D,H,L,M are longitudinal cracks (LC).  
<B>,<C>,<O> are long slugs (LS). (F),(K) are short slugs (SS).

Fig. 6 Elevation of PVRC 251J showing the actual locations of 15 flaws as characterized in Table 3. After Yukawa (1984).

[PVRC] SECT8403X.DP2


# ACTUAL FLAW LOCATIONS (YUKAWA, 84-03-22): SUB-BLOCK 1

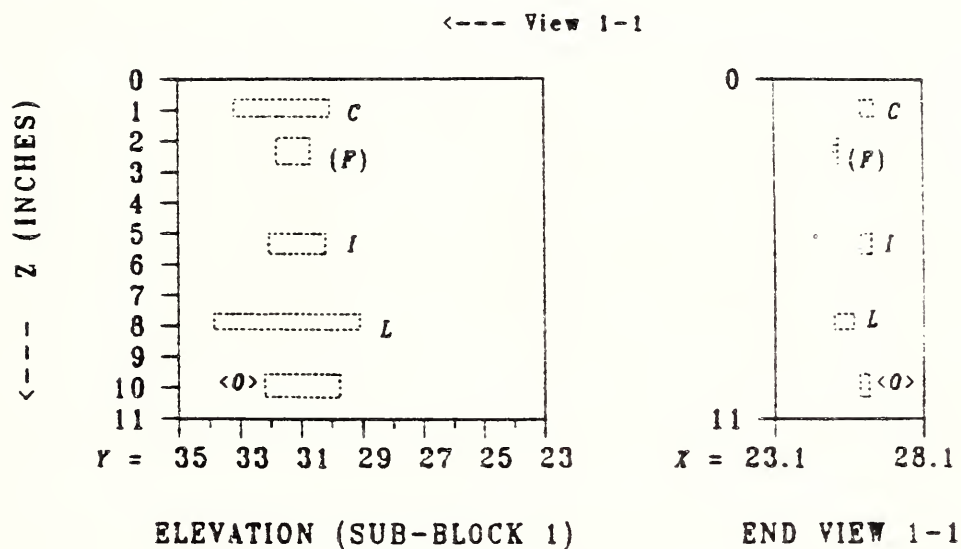

*C & L are longitudinal cracks. I is a cross crack.  
(F): short slag. <O>: long slag. Scale in inches.*

Fig. 7 Elevation and End View of Sub-Block 1 to show actual locations of 5 flaws (Yukawa, 1984).

ACTUAL FLAW LOCATIONS (YUKAWA, 84-03-22): SUB-BLOCK 2

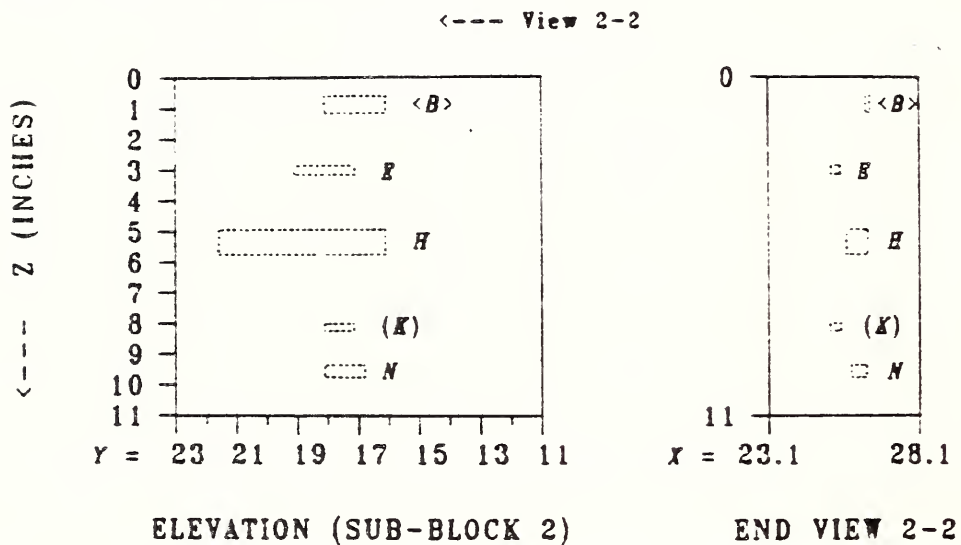


<B> is a long slag. E and N are cross cracks.  
H: longitudinal crack. (K): short slag. Scale in inches.

Fig. 8 Elevation and End View of Sub-Block 2 to show actual locations of 5 flaws (Yukawa, 1984).



[PYRC] SECT8403Z.DP2


ACTUAL FLAW LOCATIONS (YUKAWA, 84-03-22): SUB-BLOCK 3

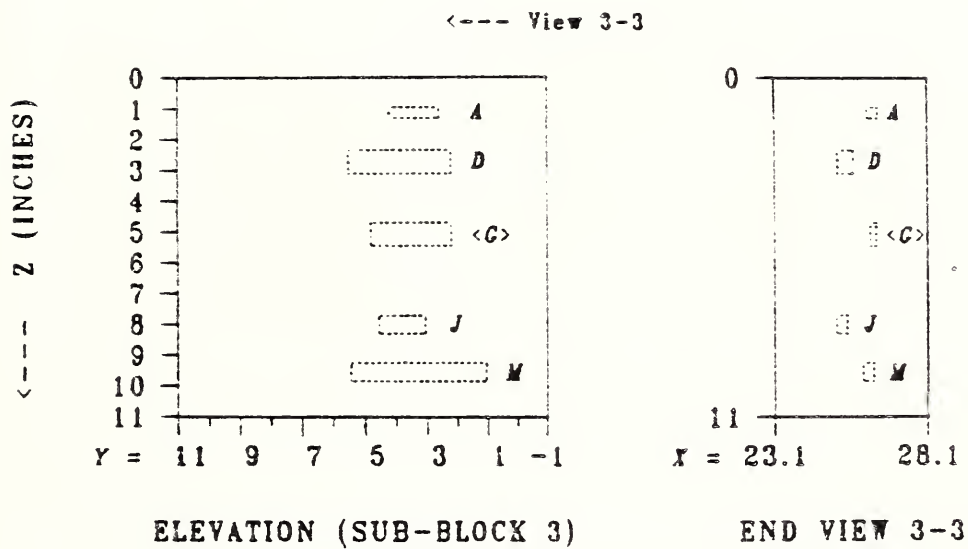

A & J are cross cracks. <C> is a long slag.  
D and M are longitudinal cracks. Scale in inches.

Fig. 9 Elevation and End View of Sub-Block 3 to show actual locations of 5 flaws (Yukawa, 1984).

PVRC 251J: INTENDED FLAWS (SOLID) VS. ACTUAL (DOTTED)

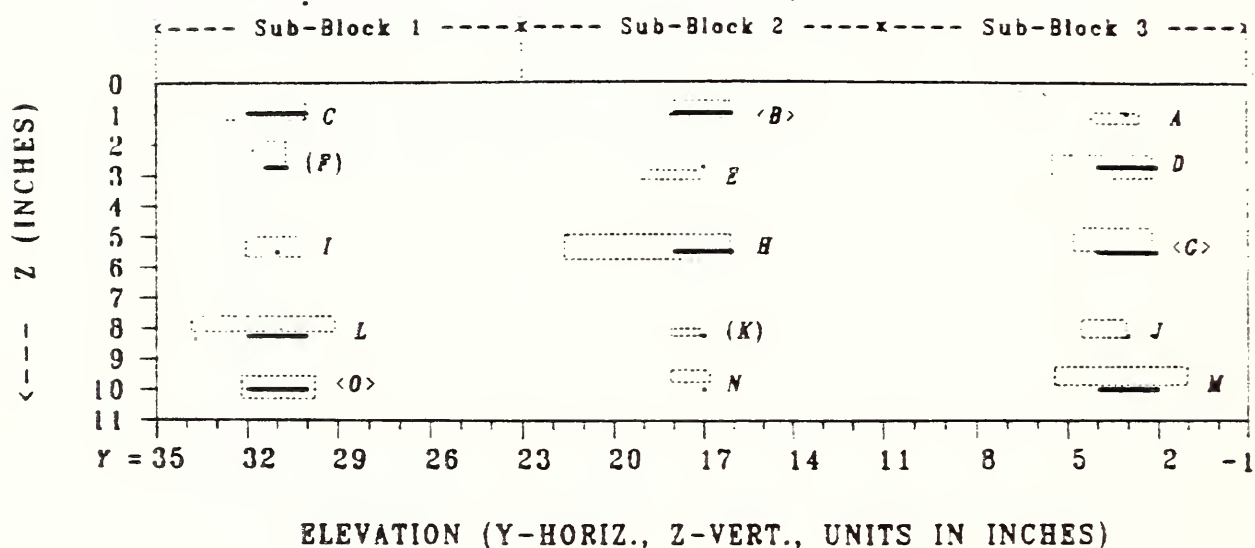

A,E,I,J,N are cross cracks (CC). C,D,H,L,M are longitudinal cracks (LC).  
 <B>,<G>,<O> are long slugs (LS). (F),(K) are short slugs (SS).

Fig. 10 Comparison of Intended (Solid Line) vs. Actual (Dotted Line) Locations of 15 Flaws as shown in the Elevation of the Entire Block 251J.

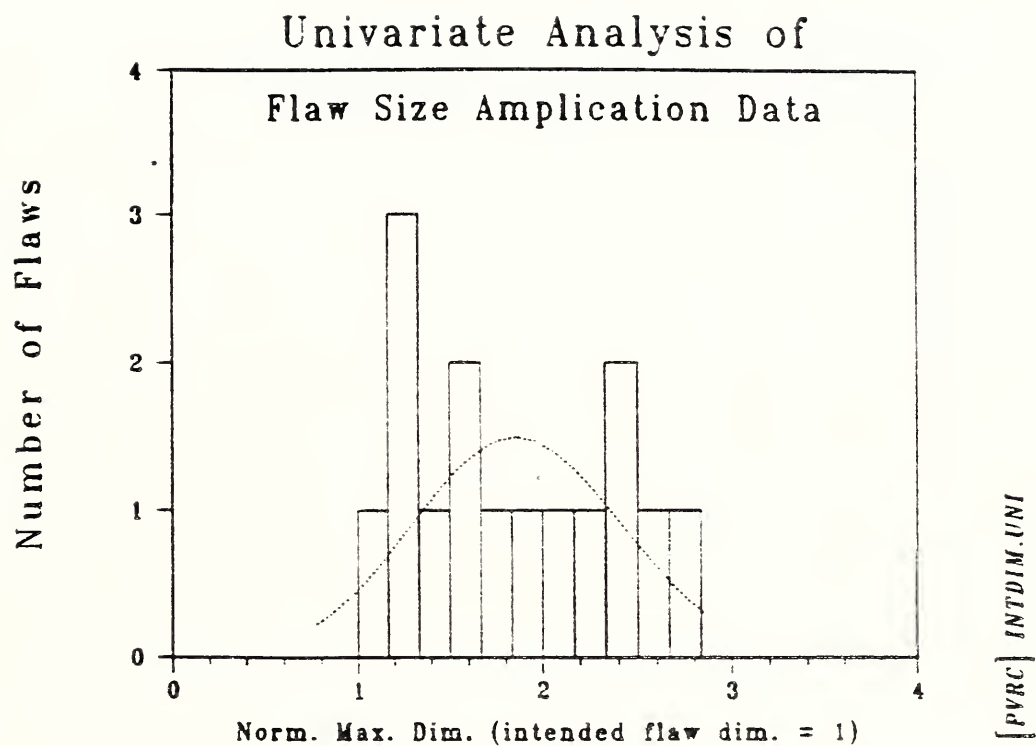


Fig. 11 Histogram and Normal Distribution Plot for Normalized Maximum Flow Dimension Data (Intended Maximum Dimension equals unity).

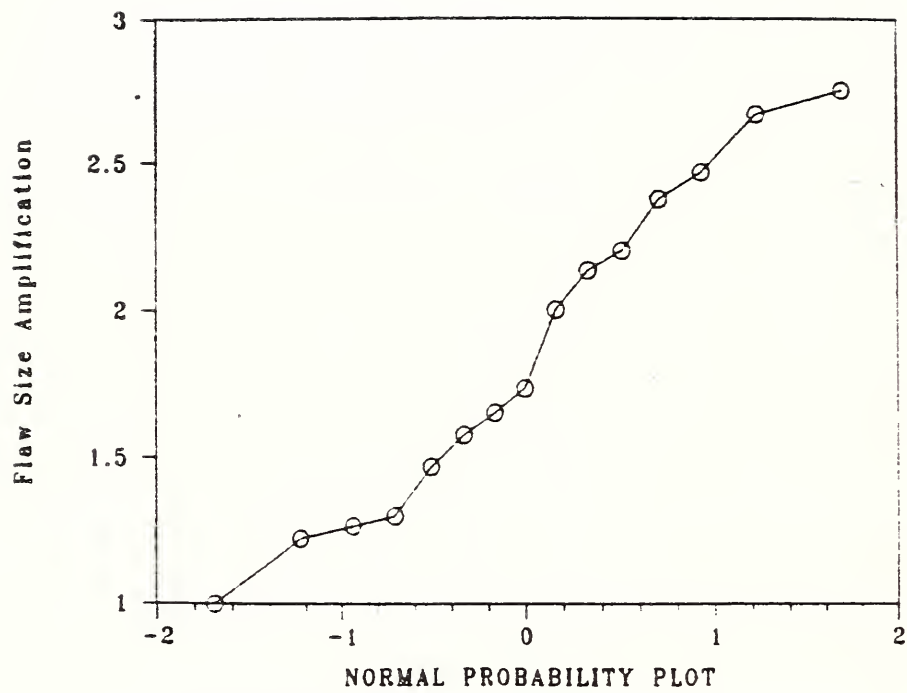


Fig. 12 Probability Plot for Testing a Normal Distribution Fit for Flaw Size Amplification Data



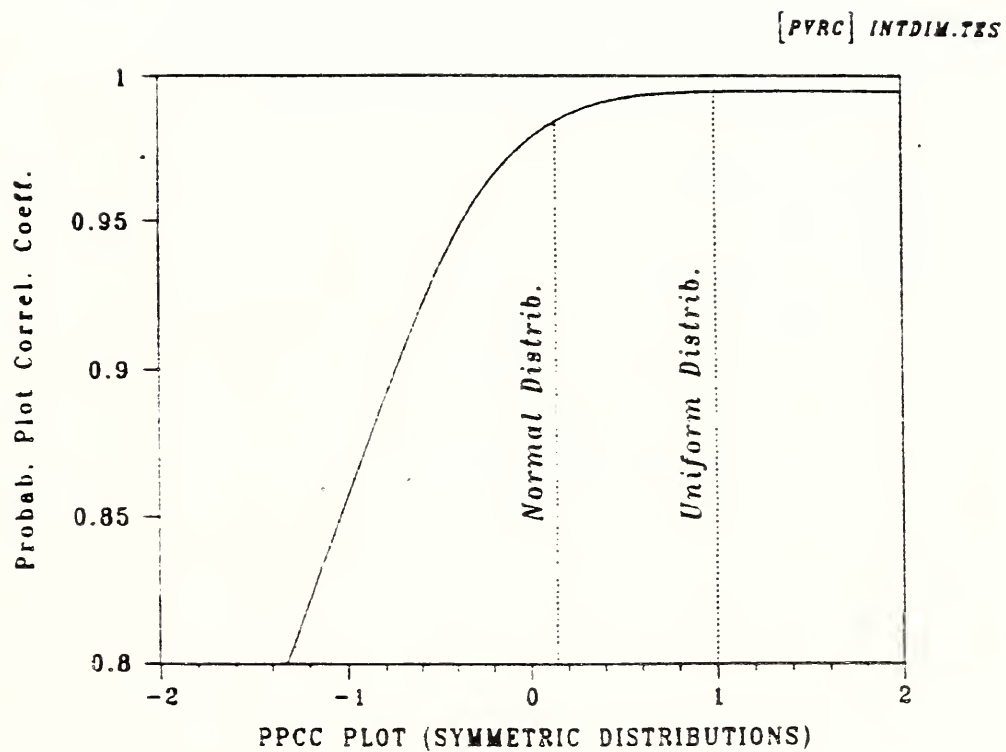


Fig. 13

Lambda Test for Symmetric Distribution Fit of  
Flaw Size Amplification Data. After Filliben  
(1969) and Joiner-Rosenblatt (1971).

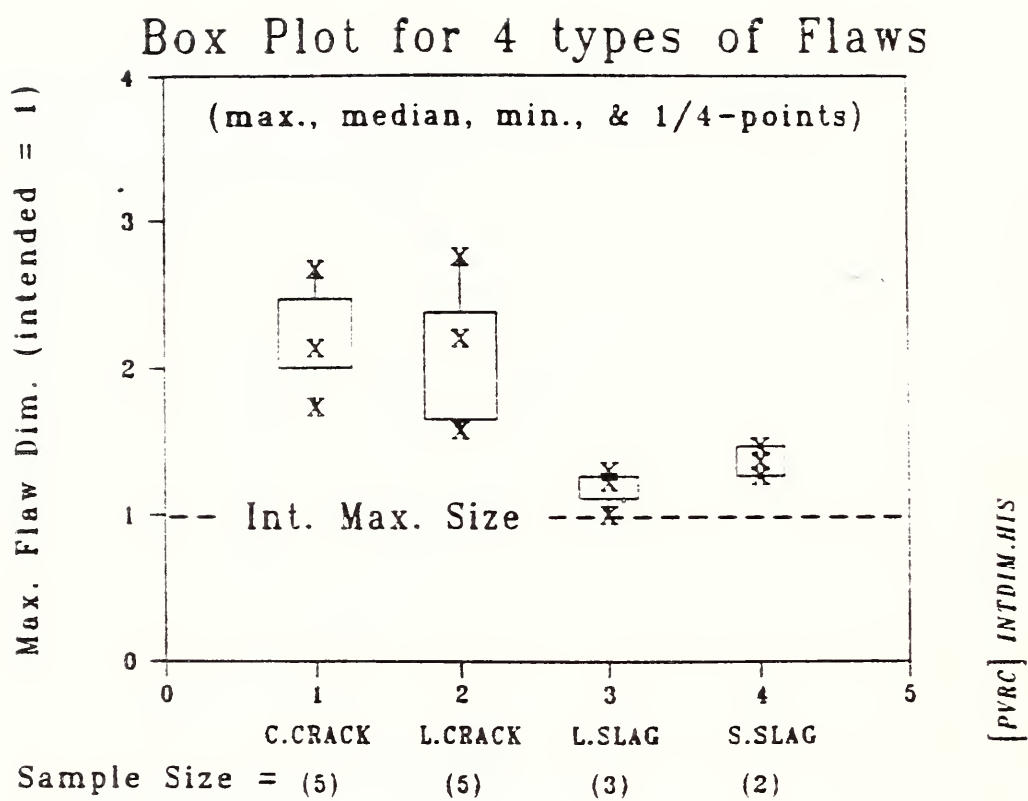


Fig. 14      Box Plot for 4 Different Types of Flaws to check suitability of introducing Analysis of Variance (ANOVA) for estimating between-type variability.

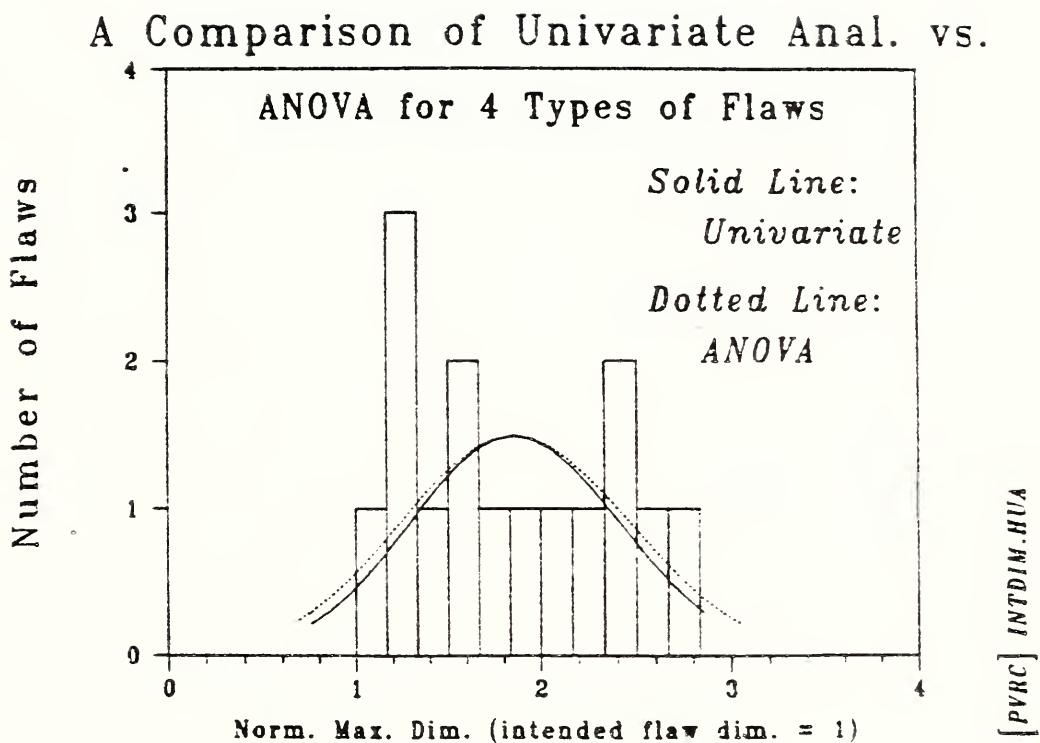


Fig. 15 Normal Distribution Plots for Normalized Maximum Dimension Data with or without estimating the between-type variability.

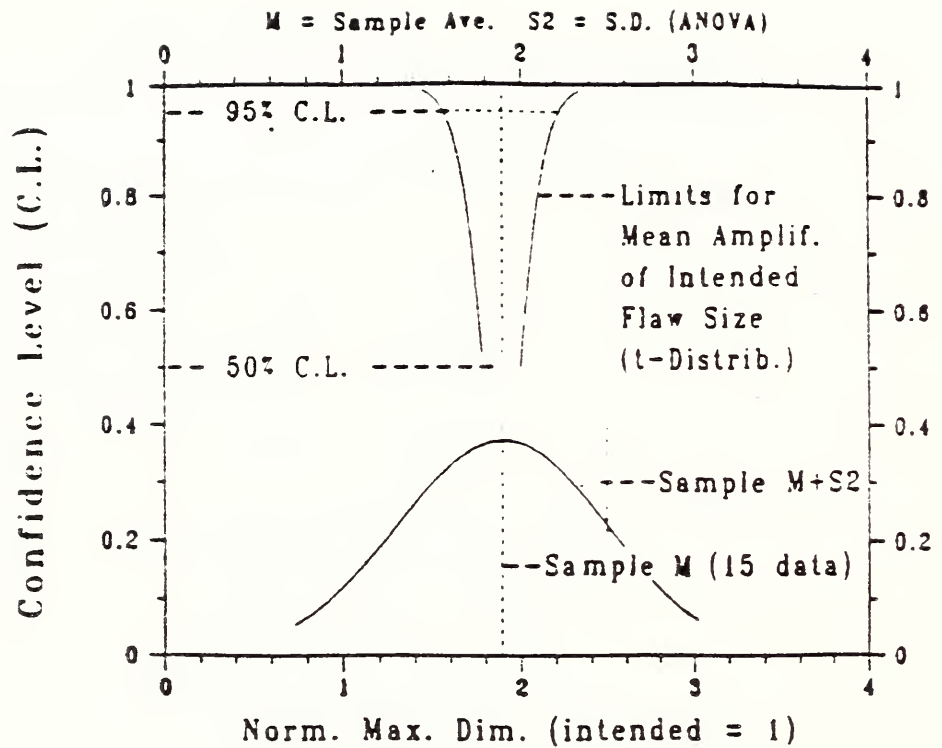


Fig. 16 Upper and Lower Limits for Mean Amplification of Intended Flaw Size for Confidence Levels between 50% and 95%.



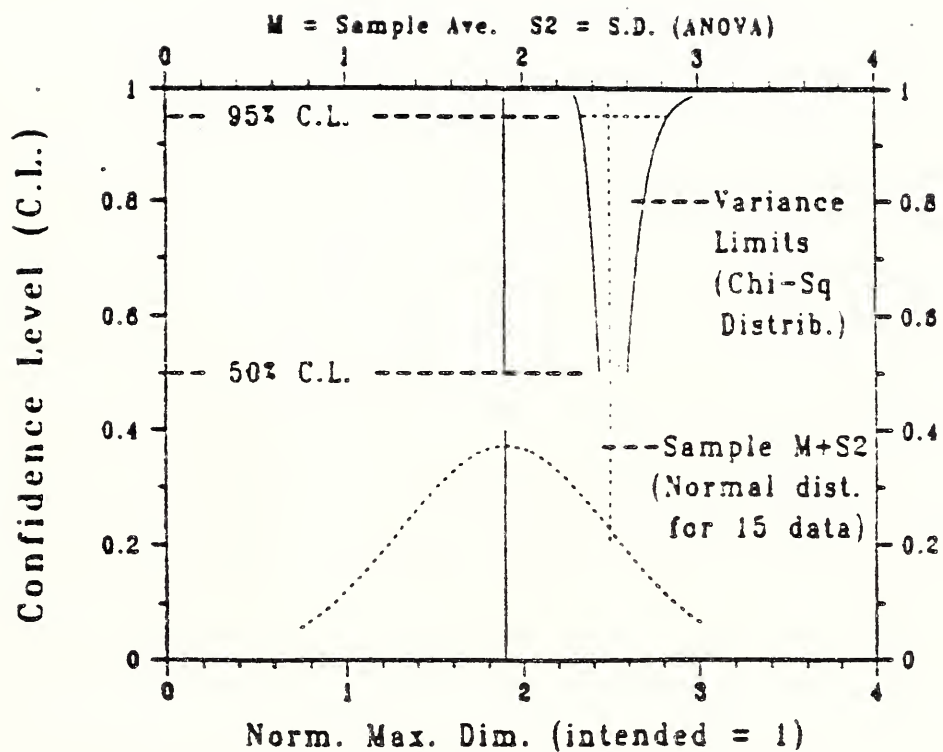


Fig. 17 Upper and Lower Limits for Variance of the Flaw Size Data for Confidence Levels between 50% and 95%.

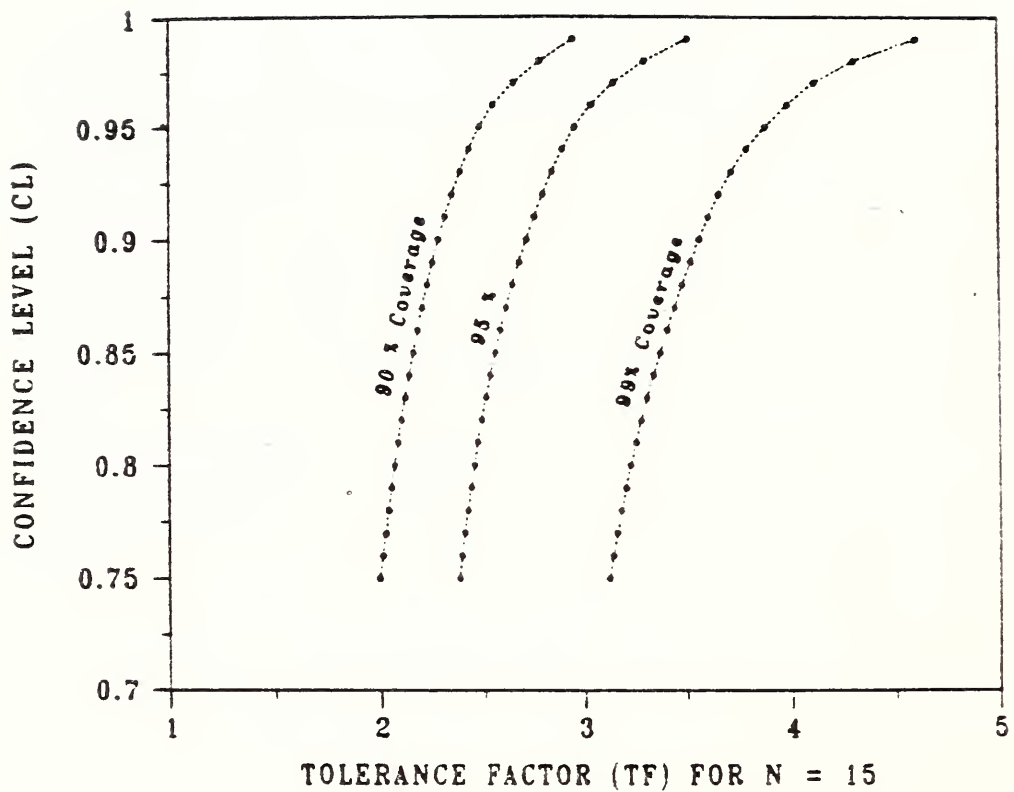


Fig. 18

Tolerance Factors (TF or K) for Sample Size  $N=15$  and 3 population coverages (90%, 95%, & 99%), as interpolated from Tables 4, 5, & 6 (Beyer, 1966).


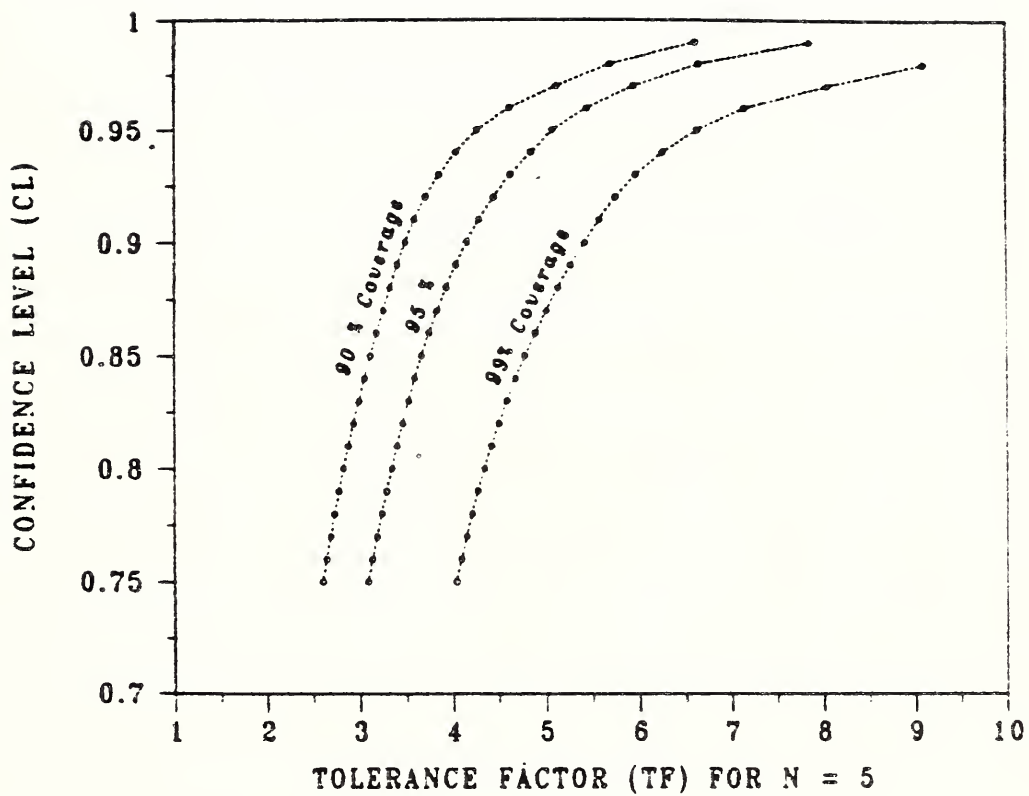


Fig. 19 Tolerance Factors (TF or K) for Sample Size  $N = 5$  and 3 population coverages (90%, 95%, & 99%), as interpolated from Tables 4, 5, & 6 (Beyer, 1966).

## Reliability of Flaw Fabrication

No. of Flaws = 15. No. of Types = 4.  
Data: PVRC-251J (Yukawa, 1984)

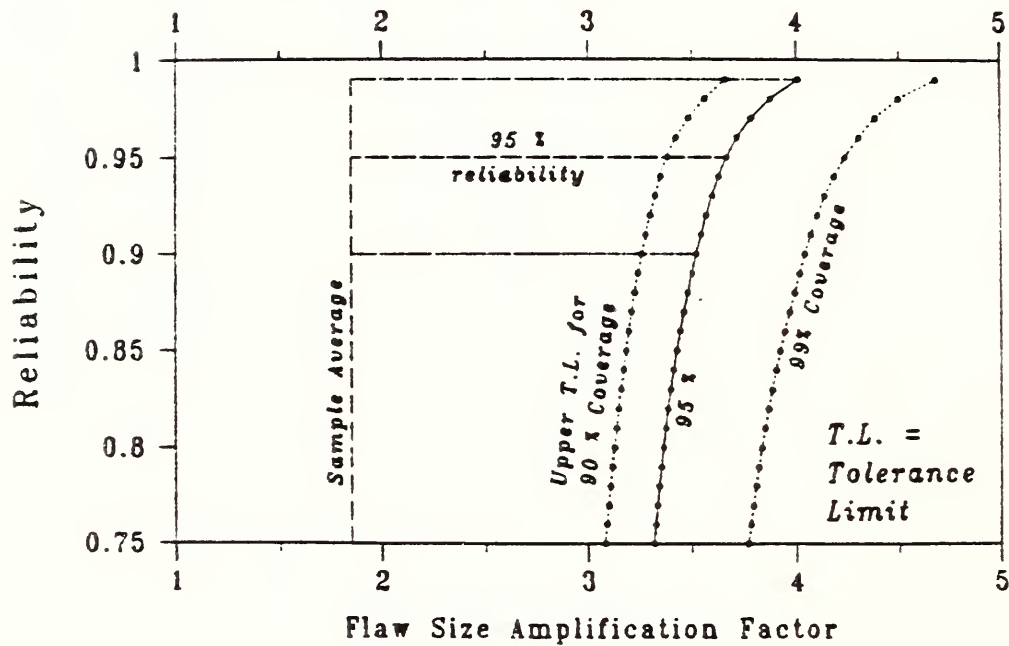


[PVRC] INTDIM15N.TOL  
via DATAPLOT™

Fig. 20

Reliability of Flaw Fabrication As Defined by the Upper Tolerance Limit Curves for 3 coverages with the inclusion of between-type variability.

## Reliability of Crack Fabrication

No. of Cracks = 5. Type: Longit. Crack.  
Data: PVRC-251J (Yukawa, 1984)

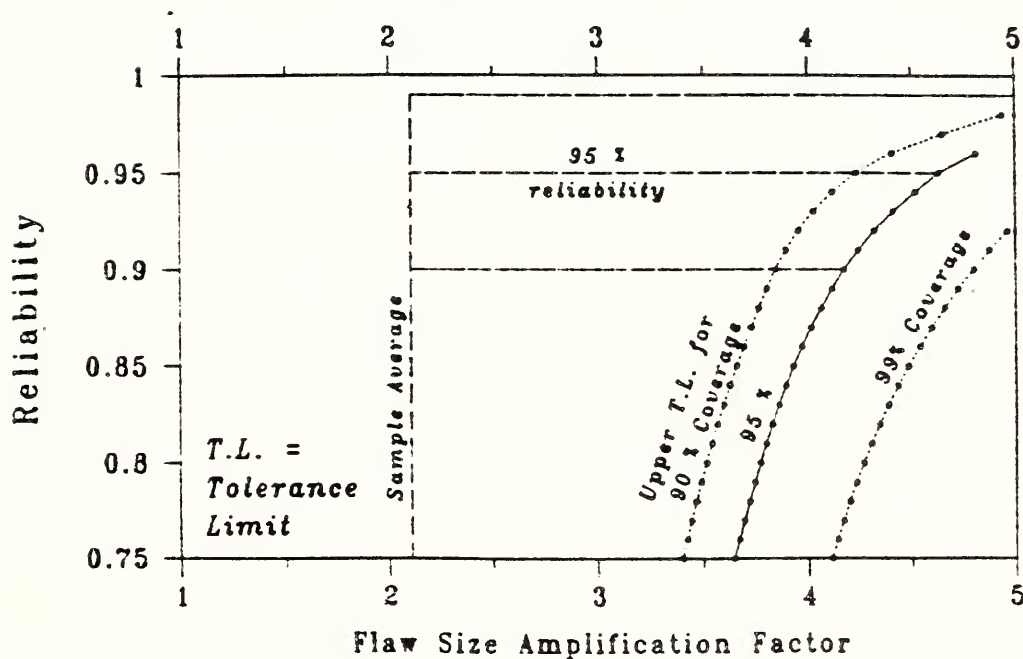

[PVRC] INTDIM5N2.TOL  
via DATAPLOT™


Fig. 21

Reliability of Longitudinal Crack Fabrication as Defined by the Upper Tolerance Limit Curves for 3 coverages.



## Reliability of Crack Fabrication

No. of Cracks = 5. Type: Cross Crack.  
Data: PVRC-251J (Yukawa, 1984)

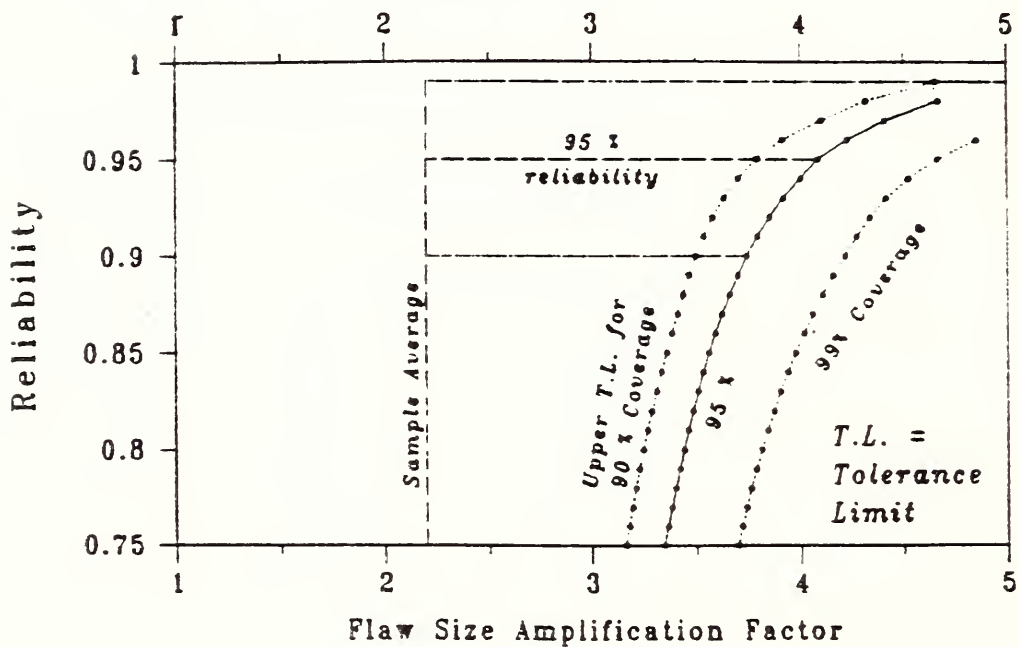


[PVRC] INTDIM5N1.TOL  
via DATAPLOT™

Fig. 22 Reliability of Cross Crack Fabrication as Defined by the Upper Tolerance Limit Curves for 3 coverages.

## Reliability of Slag Fabrication

No. of Slags = 5. No. of Types = 2.

Data: PVRC-251J (Yukawa, 1984)

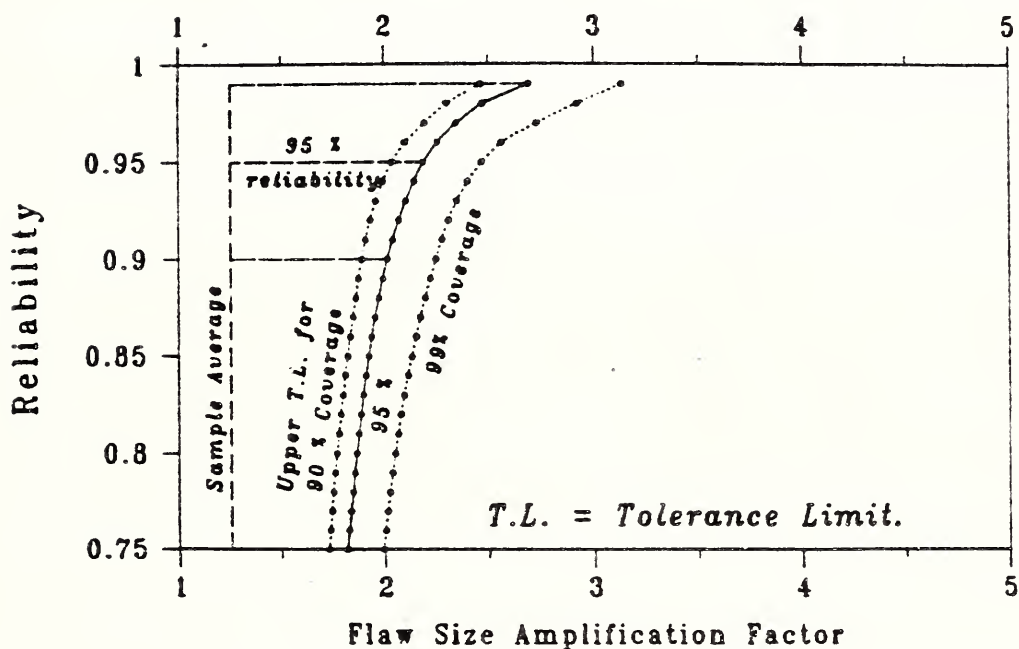


[PVRC] INTDIM3NS.TOL

via DATAPLOT™

Fig. 23 Reliability of Slag Fabrication as Defined by the Upper Tolerance Limit Curves for 3 coverages.

[PVRC] UT68A.DP

TEAM "A" - UT DATA (UNCORRECTED), 1968 PROCEDURE

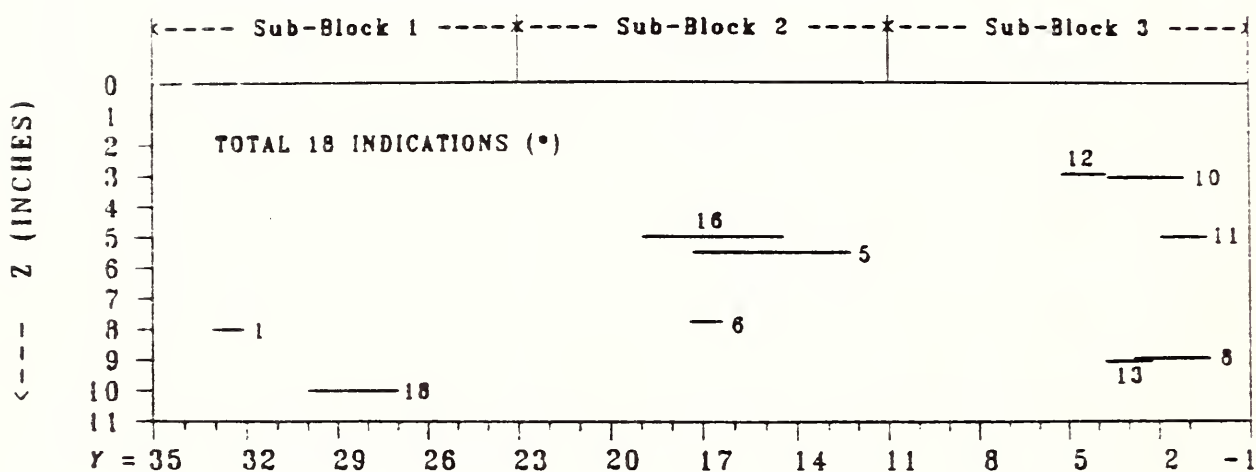

ELEVATION (Y-HORIZ., Z-VERT., UNITS IN INCHES)

(\*) Indications 2,3,4,7,9,14,15,17 do not appear  
because their z-coordinates equal or > 11.0.

Fig. 24

Elevation of PVRC 251J showing the locations of  
some or all of the indications reported by Team  
A (Ultrasonic Testing Data, Uncorrected).

[PVRC] UT68B.DP

TEAM "B" - UT DATA (Uncorrected), 1968 Procedure

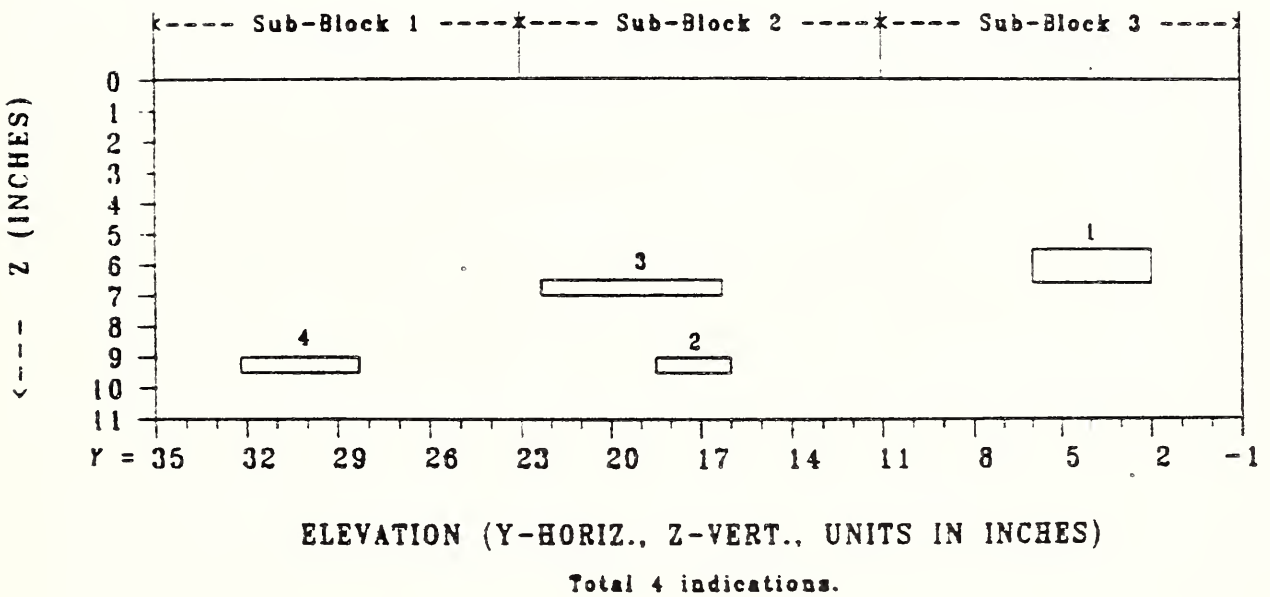


Fig. 25 Elevation of PVRC 251J showing the locations of some or all of the indications reported by Team B (Ultrasonic Testing Data, Uncorrected).

[PVRC] UT68C.DP

TEAM "C" - UT DATA (Uncorrected), 1968 Procedure

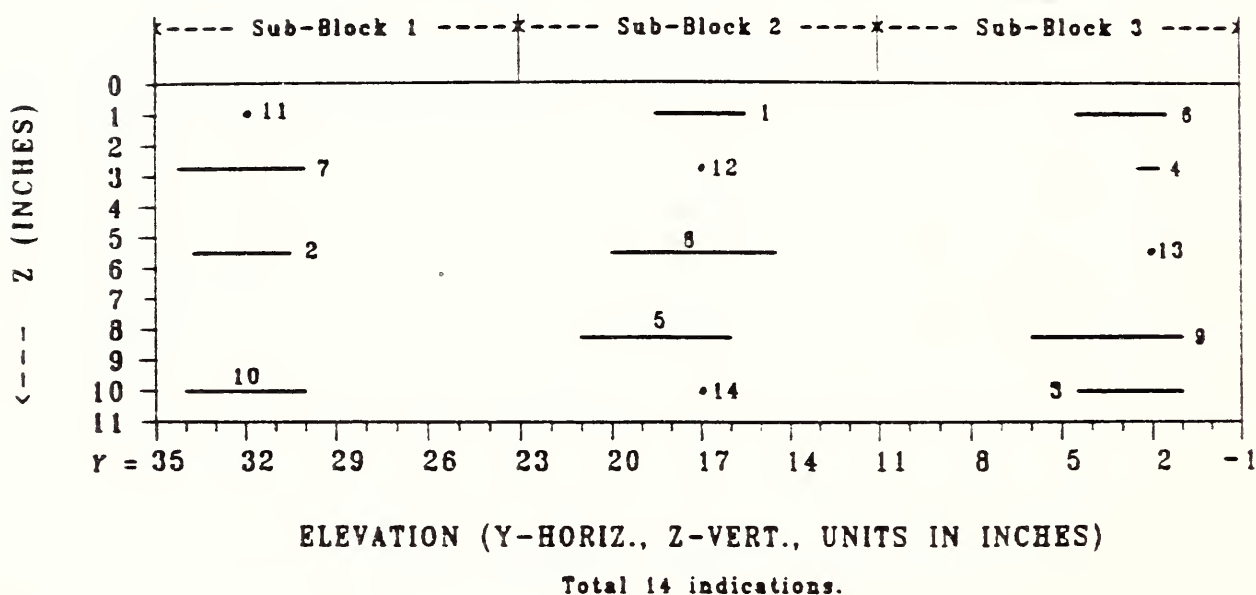


Fig. 26 Elevation of PVRC 251J showing the locations of some or all of the indications reported by Team C (Ultrasonic Testing Data, Uncorrected).



[PVRC] UT68D.DP

TEAM "D" - UT DATA (Uncorrected), 1968 Procedure

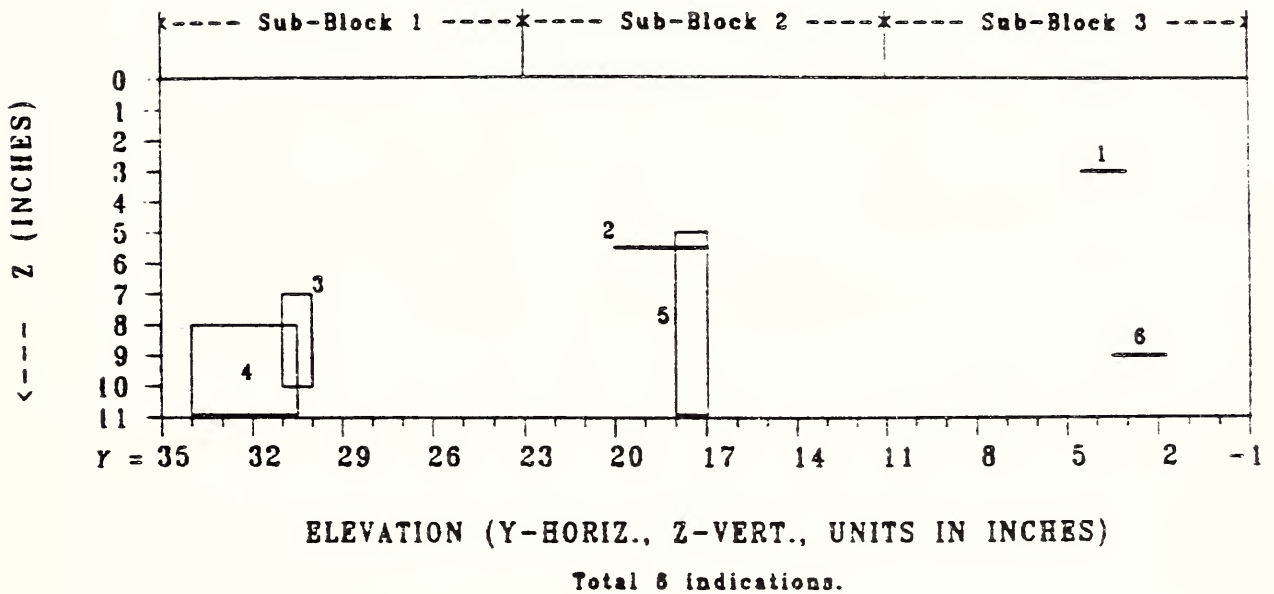


Fig. 27

Elevation of PVRC 251J showing the locations of some or all of the indications reported by Team D (Ultrasonic Testing Data, Uncorrected).

[PVRC] UT68P.DP

TEAM "F" - UT DATA (Uncorrected), 1968 Procedure


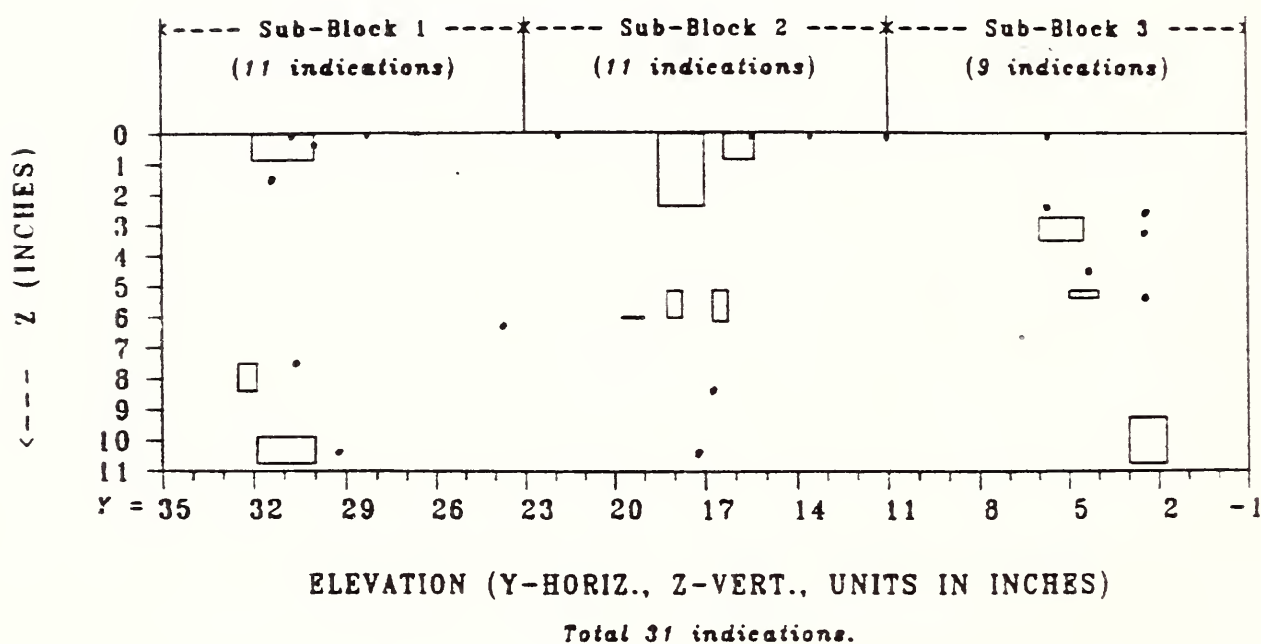


Fig. 28

Elevation of PVRC 251J showing the locations of some or all of the indications reported by Team F (Ultrasonic Testing Data, Uncorrected).

[PVRC] UT63AX.DP

TEAM "A" - UT DATA (HEDDEN, 84-02-17), 1968 PROCEDURE

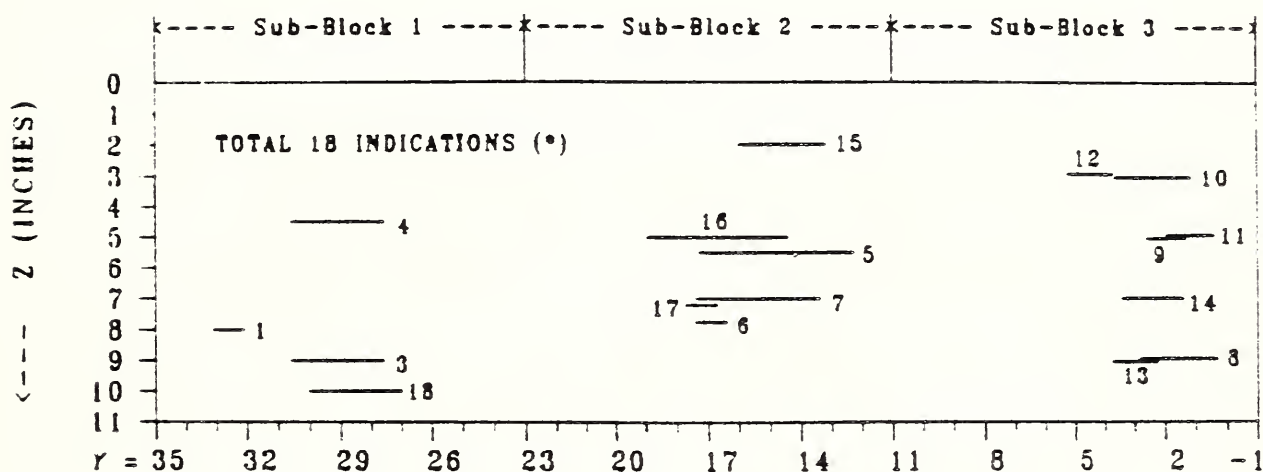

ELEVATION (Y-HORIZ., Z-VERT., UNITS IN INCHES)

(\*) Indication 2 does not appear because its z-coordinate equals 11.0.

Fig. 29 Elevation of PVRC 251J showing the locations of some or all of the indications reported by Team A (UT Data, Corrected by Hedden, Feb. 17, 1984).

[PVRC] UT68AY.DP

TEAM "A" - UT DATA (HEDDEN, 84-03-07), 1968 PROCEDURE


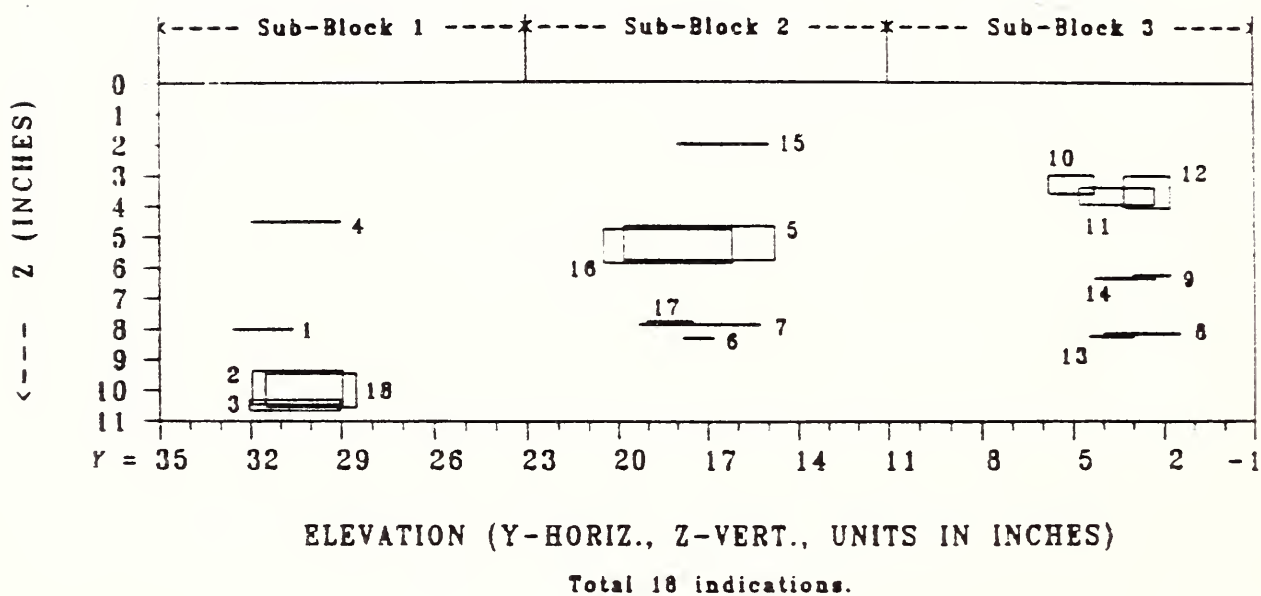


Fig. 30

Elevation of PVRC 251J showing the locations of some or all of the indications reported by Team A (UT Data, Corrected by Hedden, Mar. 7, 1984).


# UT-1968-Team A: Indication #1

## Flaw Detection Analysis

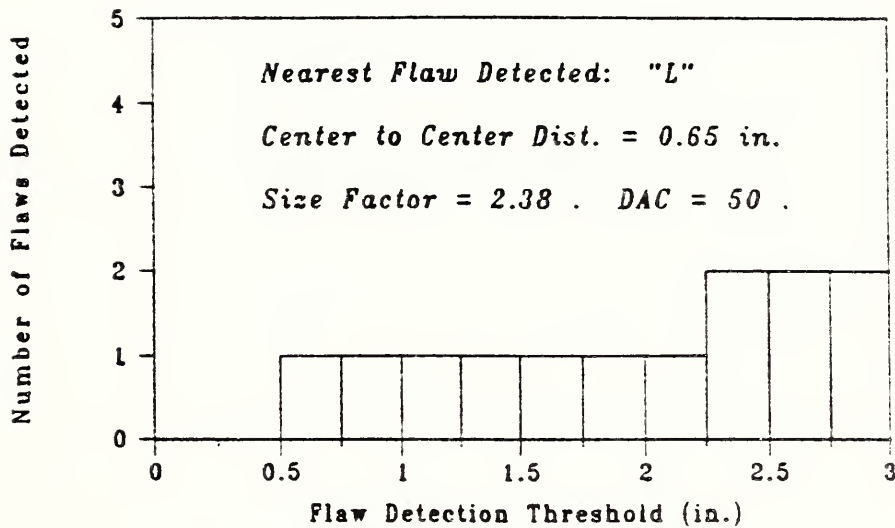

[PVRC] UT68AY01.DPI

via DATAPLOT™

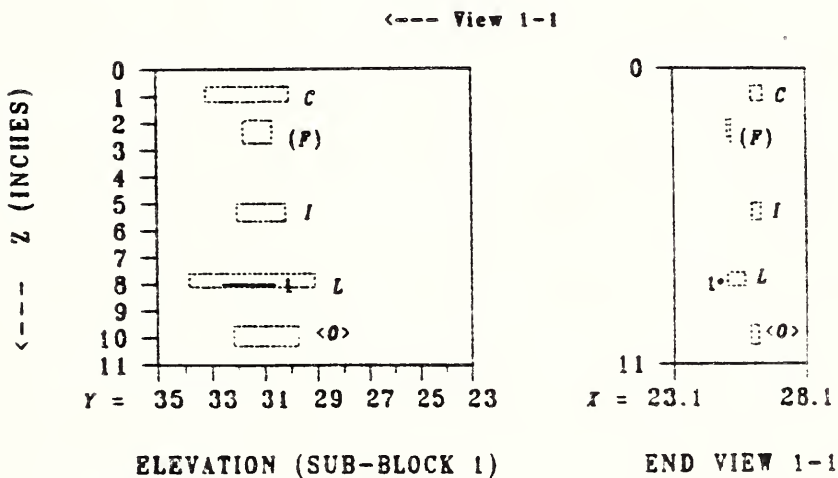

C & L are longitudinal cracks. I is a cross crack.  
(P): short slag. <O>: long slag. Scale in inches.


Fig. 31

Typical Result of an Automated Flaw Detection Analysis with a Variable Detection Threshold to Parametrize the Decision-Making Process.




# UT-1968-Team A: Indication #12

## Flaw Detection Analysis

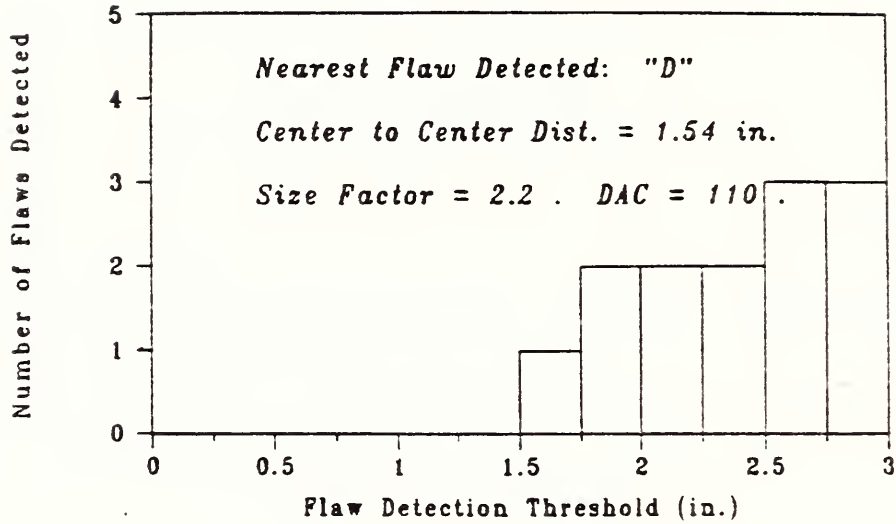

[PVNC] UT88AY12.DPI

via DATAPLOT

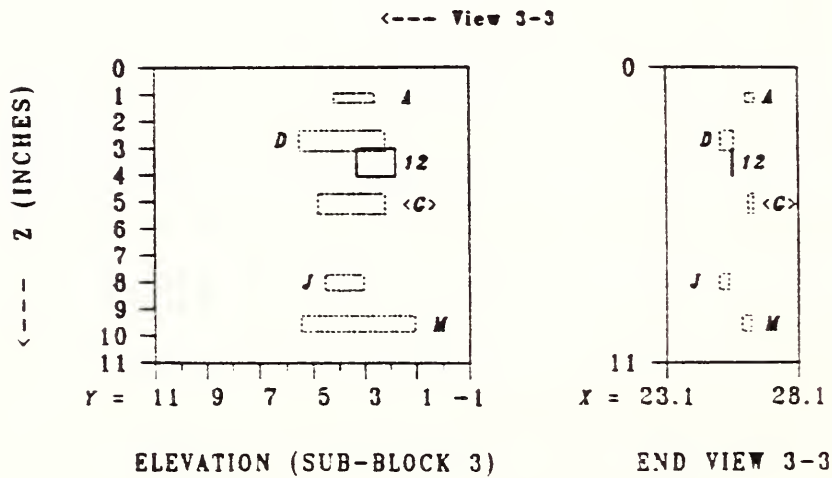


A & J are cross cracks. <G> is a long slag.  
D and M are longitudinal cracks. Scale in inches.

Fig. 32

A Special Case of Flaw Detection Analysis where a call for a unique detection is too sensitive to the choice of a detection threshold.


# UT-1968-Team A: Indication #14

## Flaw Detection Analysis

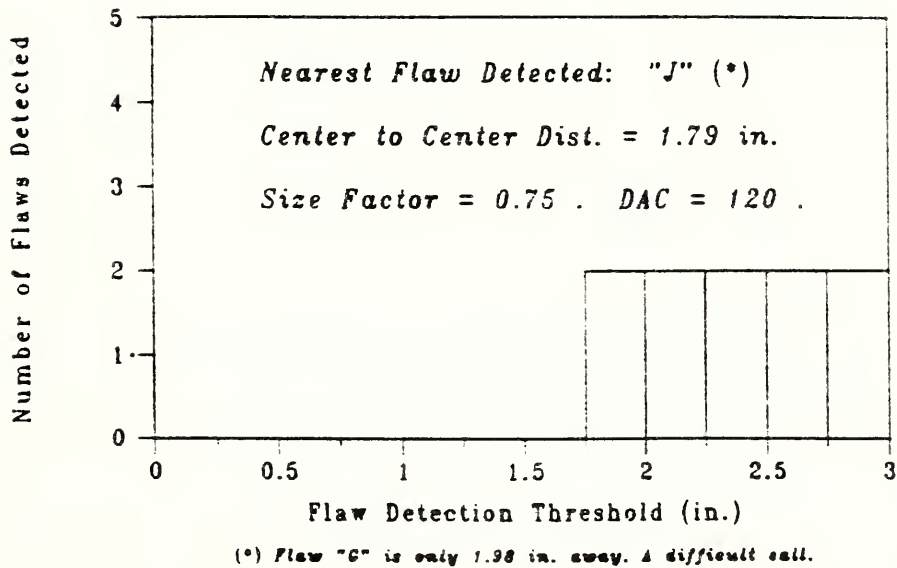

[PVR] UT88AY14.DPI

via DATAPLOT

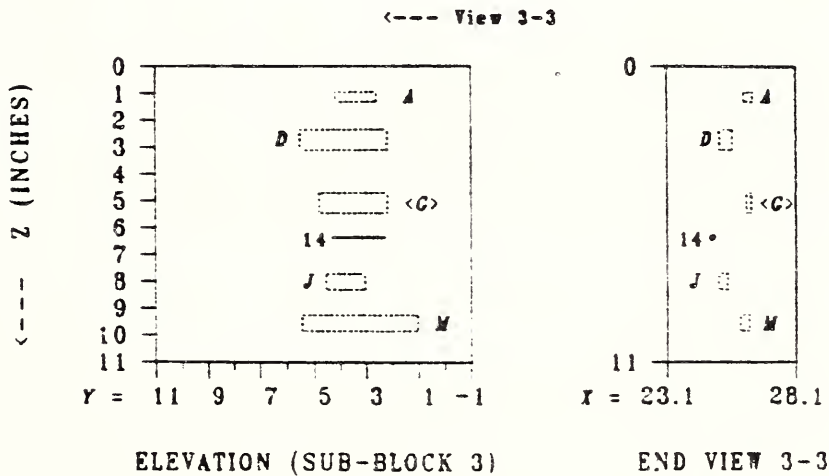

A & J are cross cracks. <G> is a long slag.  
D and M are longitudinal cracks. Scale in inches.

Fig. 33 A Special Case of Flaw Detection Analysis where a call for a unique detection does not exist.

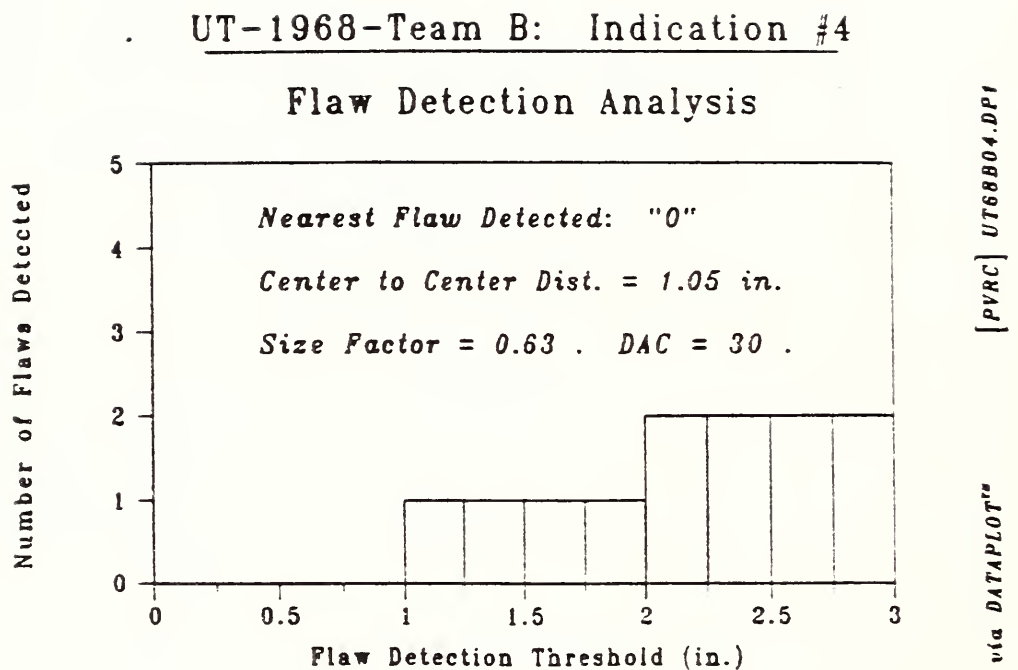


Fig. 34 A Typical Case of Flaw Detection Analysis for all indications reported by Team B (Ultrasonic Testing Data, Uncorrected).

UT-1968-Team C: Indication #5

Flaw Detection Analysis

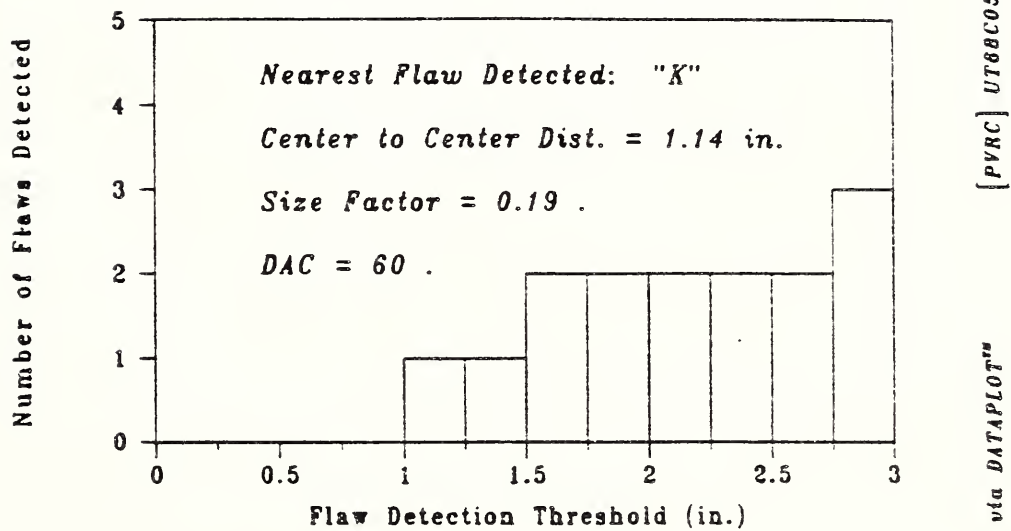


Fig. 35

A Special Case of Flaw Detection Analysis for Indications Reported by Team C, where the size factor is extremely small.

# UT-1968-Team C: Indication #11

## Flaw Detection Analysis


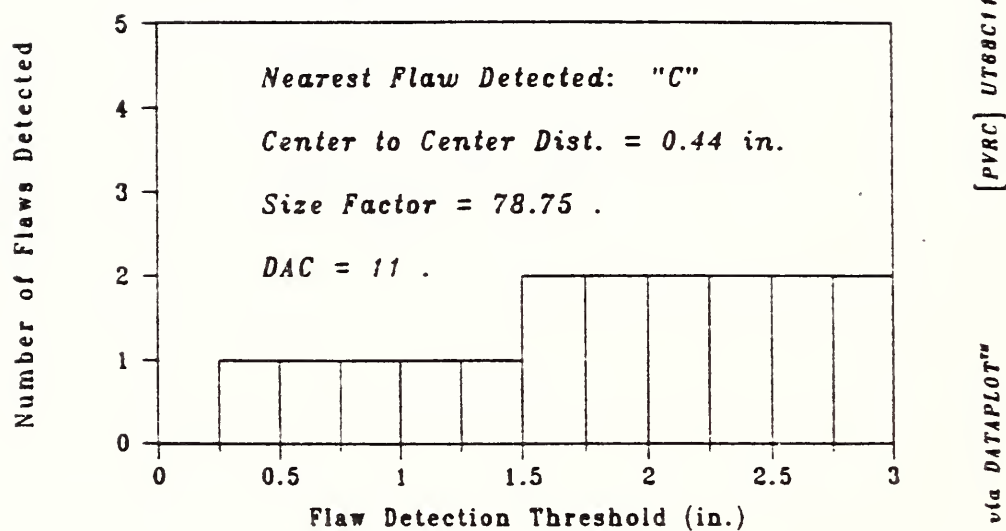


Fig. 36 A Special Case of Flaw Detection Analysis for Indications Reported by Team C, where the size factor is extremely Large.



UT-1968-Team D: Indication #1

Flaw Detection Analysis

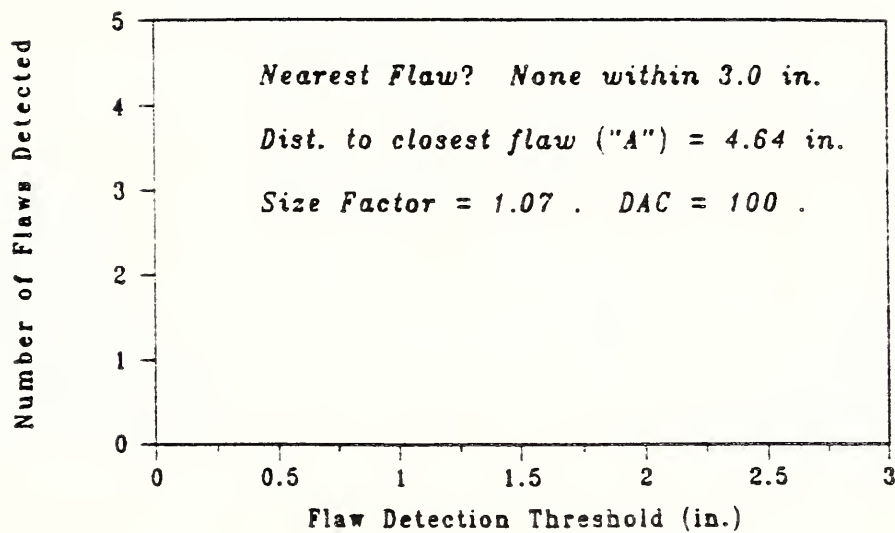

[PVRC] UT68D01.DP1

via DATAPLOT

Fig. 37

A Problem Case of Flaw Detection Analysis for  
Indications Reported by Team D.

## UT Flaw Detection Probability

*PVRC-251J (Hedden, 84-03-07)*

*Team: A. Procedure: 1968.*


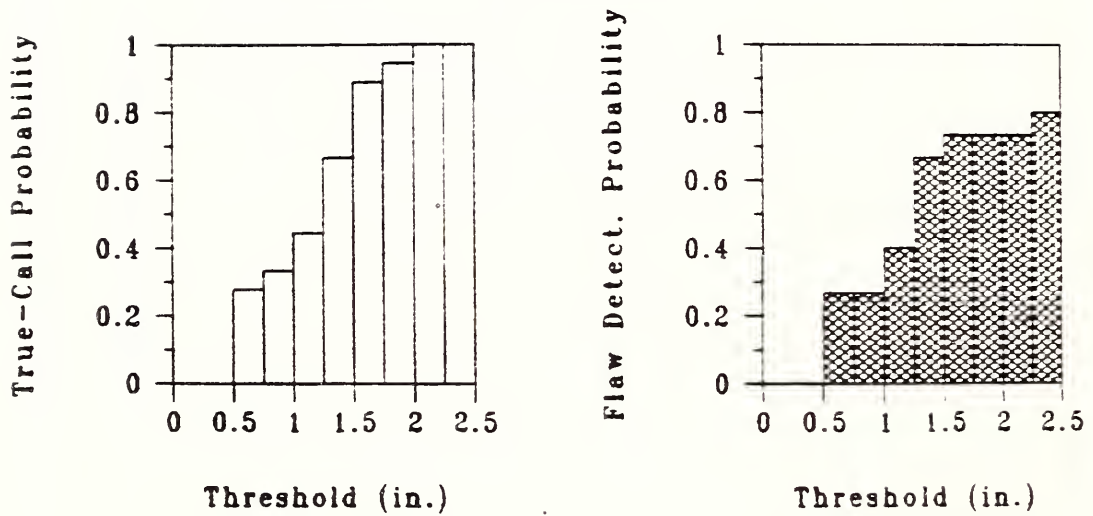


Fig. 38 True-Call and Flaw Detection Probabilities for Individual Team A (UT Data, Corrected 84-03-07).

## UT Flaw Detection Probability

*PVRC-251J (Uncorrected Data)*

*Team: B. Procedure: 1968.*

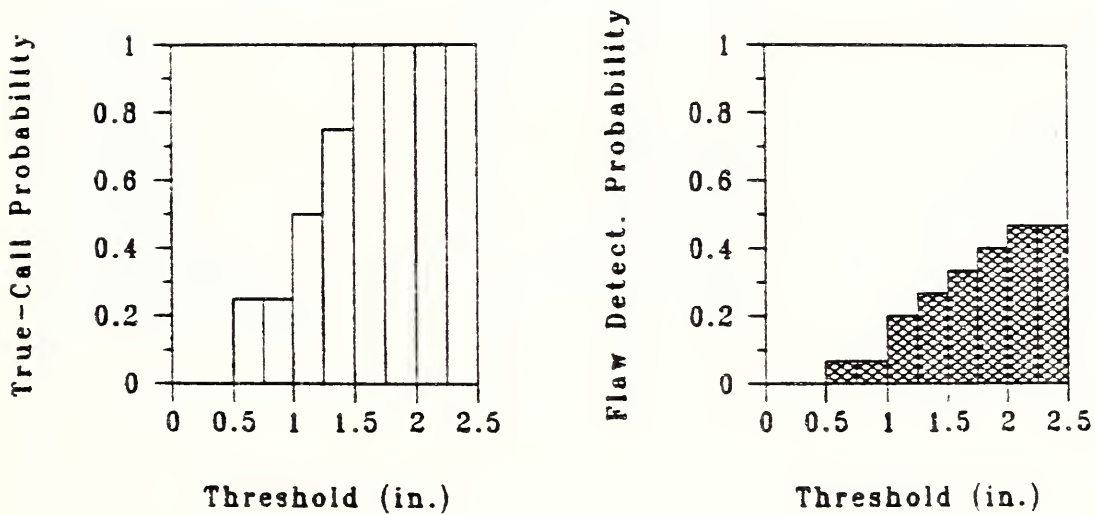

[PVRC] UT68B.DP2  
via DATAPLOT™

Fig. 39 True-Call and Flaw Detection Probabilities for Individual Team B (UT Data, Uncorrected).

## UT Flaw Detection Probability

*PVRC-251J (Uncorrected Data)*

*Team: C. Procedure: 1968.*

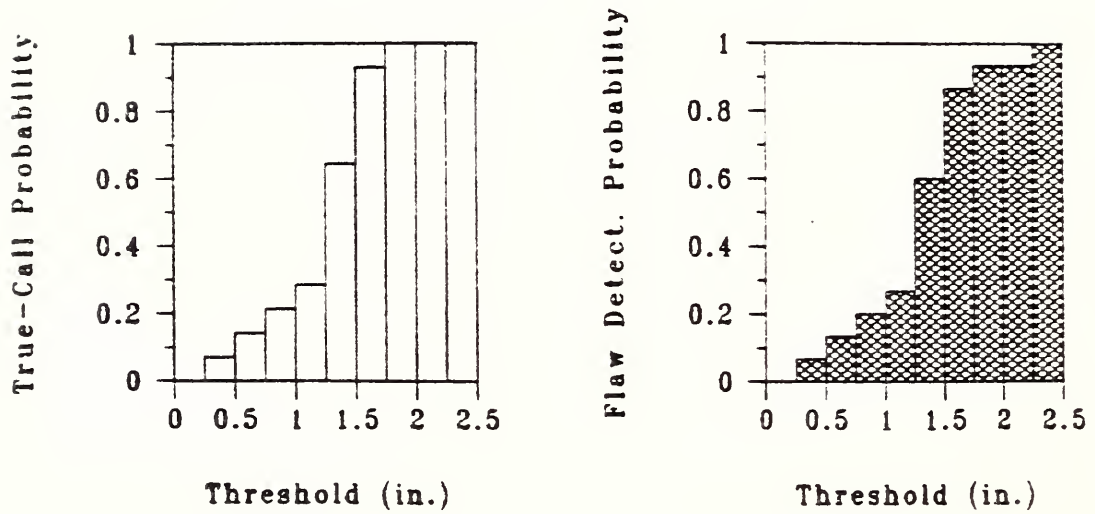


Fig. 40


True-Call and Flaw Detection Probabilities for Individual Team C (UT Data, Uncorrected).

[PVRC] UT88C.DP2  
v(a) DATAPLOT™

## UT Flaw-Type Activity Index (\*)

*PVRC-251J (Hedden, 84-03-07)*

*Team: A. Procedure: 1968.*

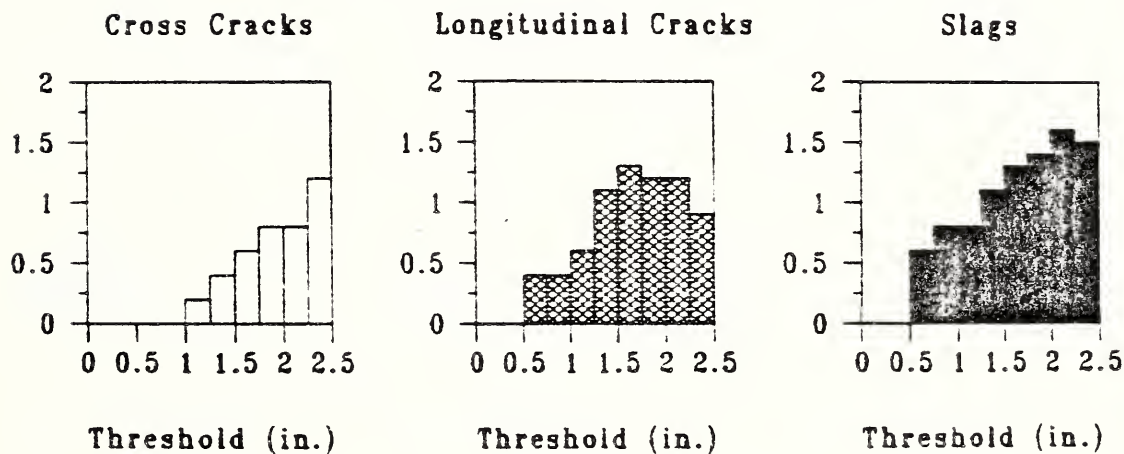

[PVRC] UT68AY.DPS  
via DATAPLOT™


(\*) No. of true calls divided by no. of possible flaws.

Fig. 41      A Performance Measure of Team A for Detection of  
3 Different Types of Flaws

## UT Flaw-Type Activity Index (\*)

*PVRC-251J (Uncorrected Data)*

*Team: B. Procedure: 1968.*

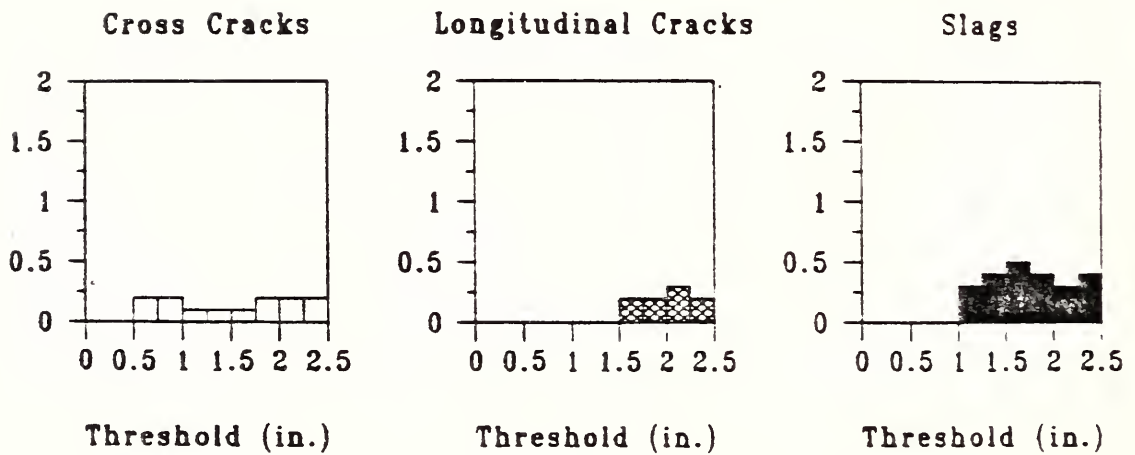

[PVRC] UT68C.DP3  
via DATAPLOT™

(\*) No. of true calls divided by no. of possible flaws.


Fig. 42      A Performance Measure of Team B for Detection of  
3 Different Types of Flaws



## UT Flaw-Type Activity Index (\*)

*PVRC-251J (Uncorrected Data)*

*Team: C. Procedure: 1968.*

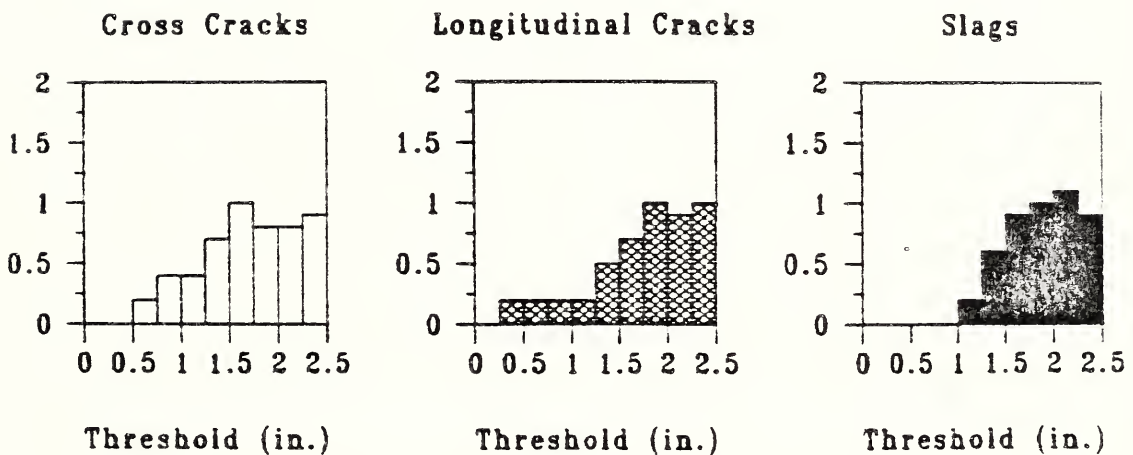

[PVRC] UT68C.DP3  
via DATAPLOT™

(\*) No. of true calls divided by no. of possible flaws.

Fig. 43      A Performance Measure of Team C for Detection of  
3 Different Types of Flaws

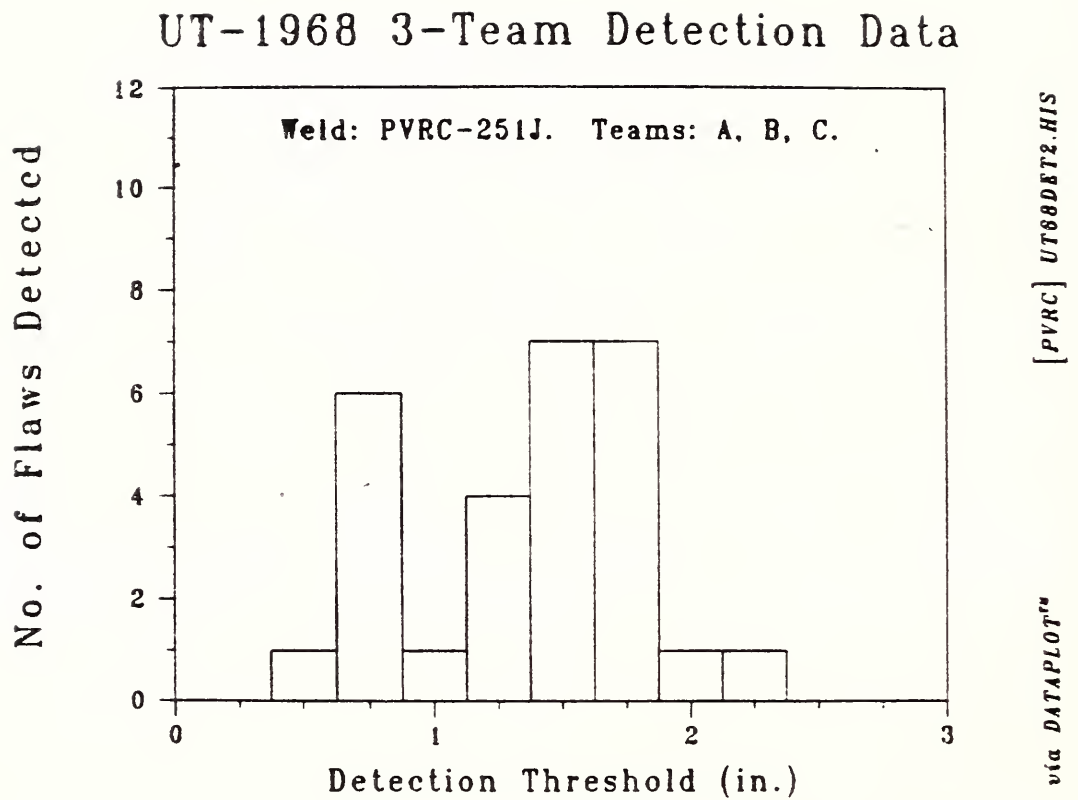


Fig. 44 Histogram of Detection Threshold for Combined 3-Team Detection Data for Reliability Modeling

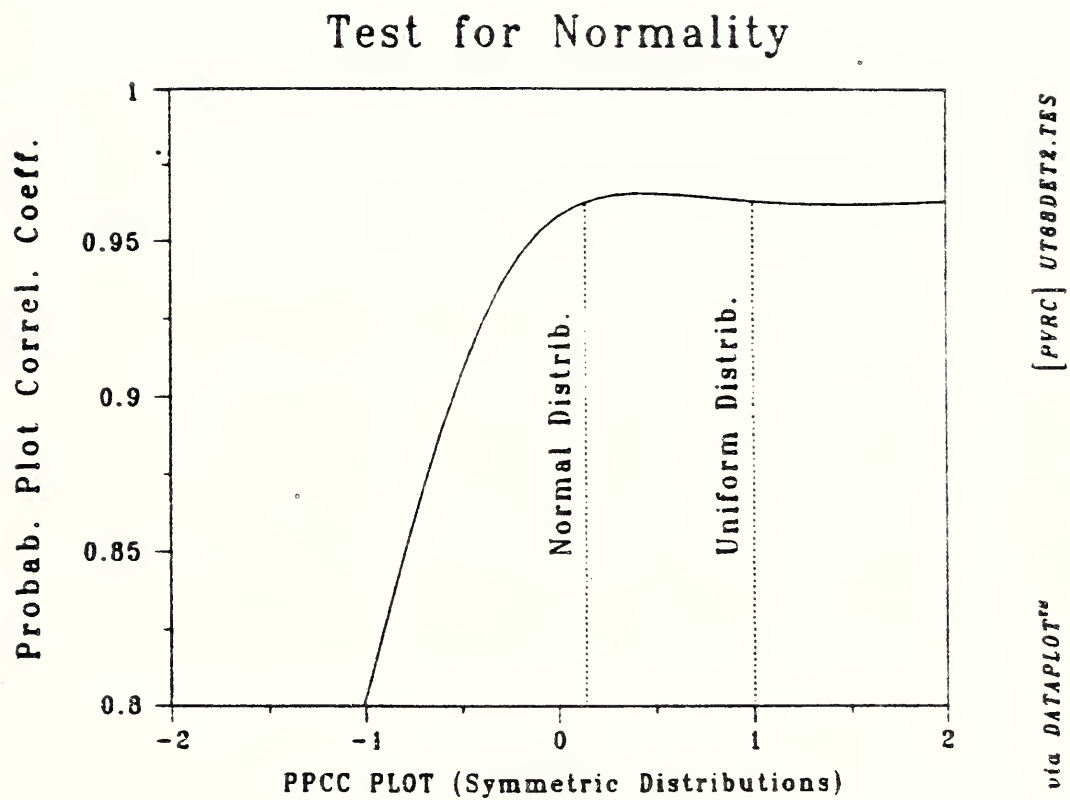


Fig. 45      Lambda Test for Symmetric Distribution Fit of  
the 3-Team Detection Threshold Data.

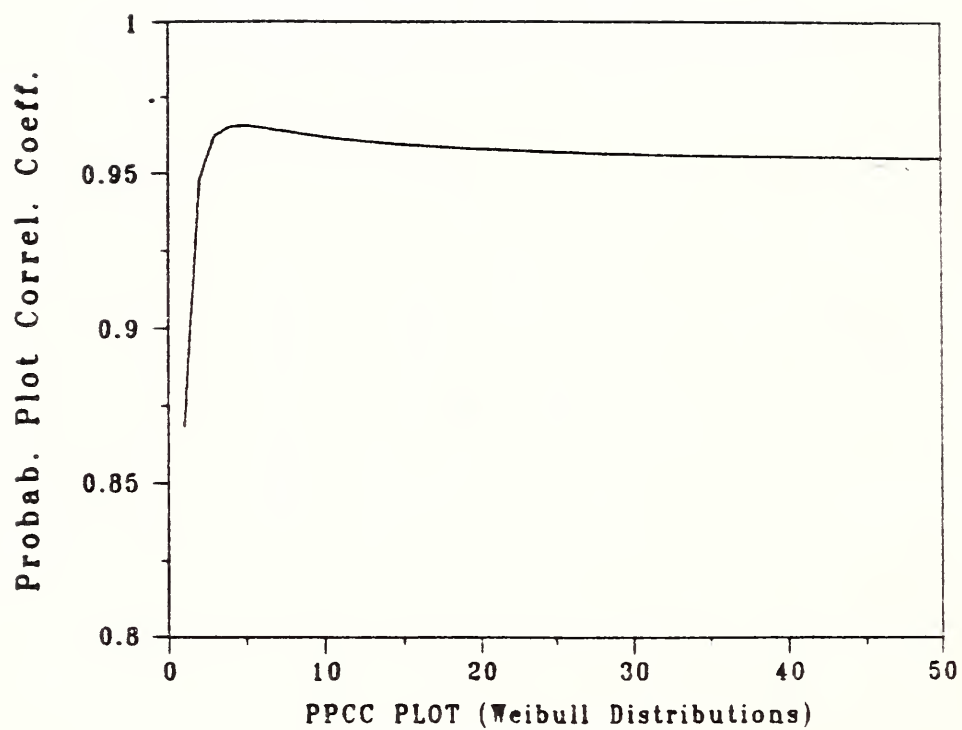


Fig. 46 Probability Plot Correlation Coefficient vs. Weibull Shape Parameter for a Test of Unsymmetric Distribution Fit.

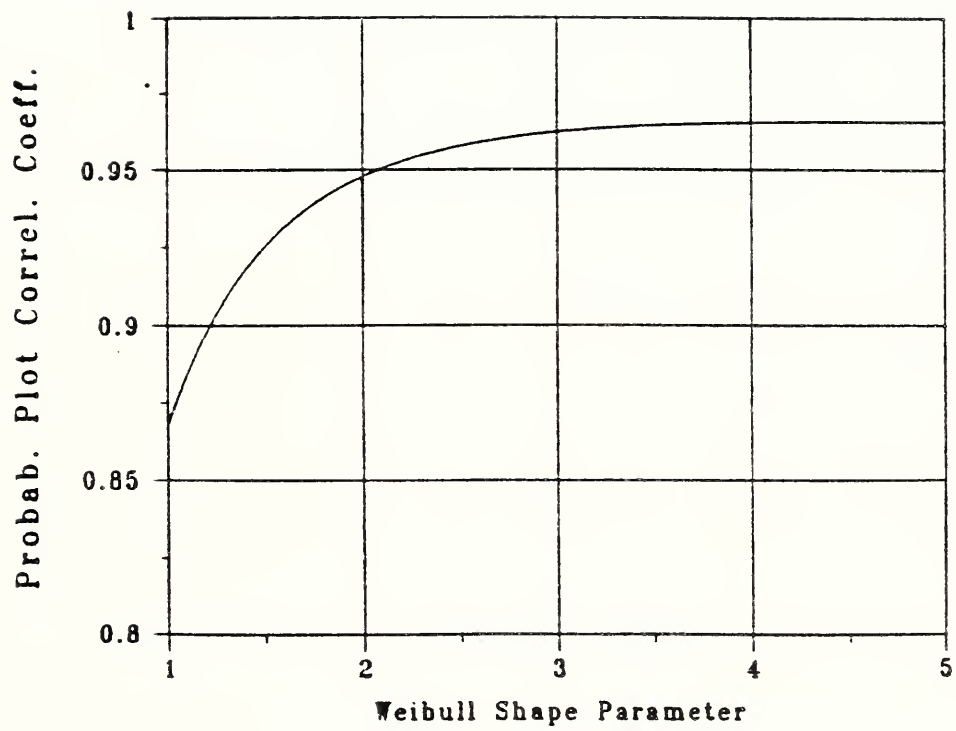


Fig. 47      An Enlarged Plot of Fig. 47 near Shape Parameter Equal to 3.6 for which Weibull approaches the shape of a Normal Distribution.

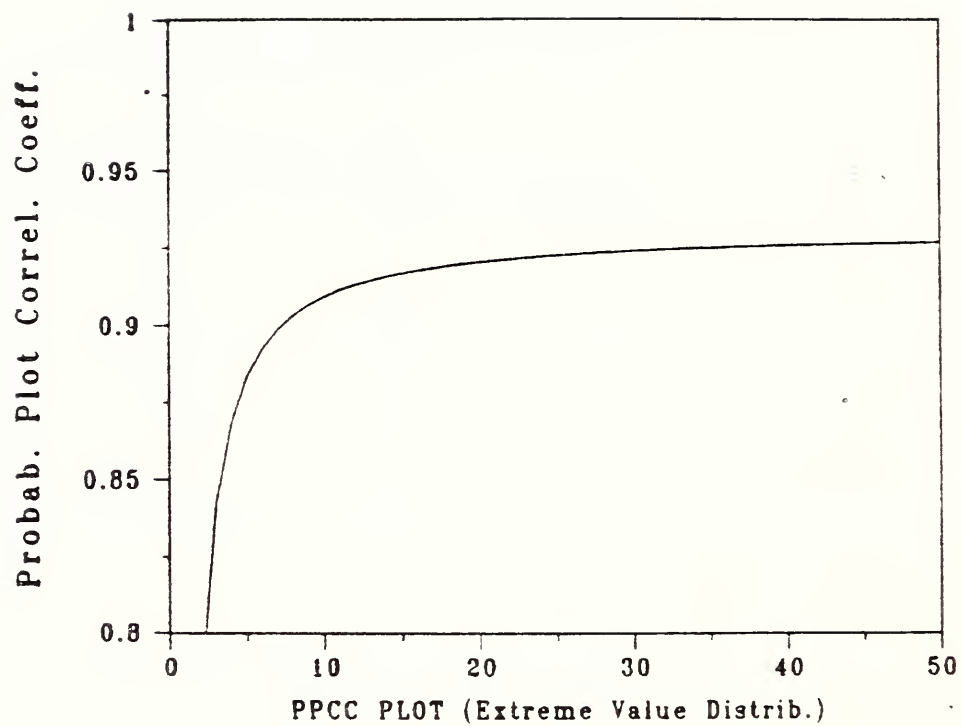


Fig. 48 Probability Plot Correlation Coefficient vs. Scale Parameter of Extreme Value Distribution as a Test for Unsymmetrical Distribution Fit.



# UT-1968 Data: Team Effect on Detection

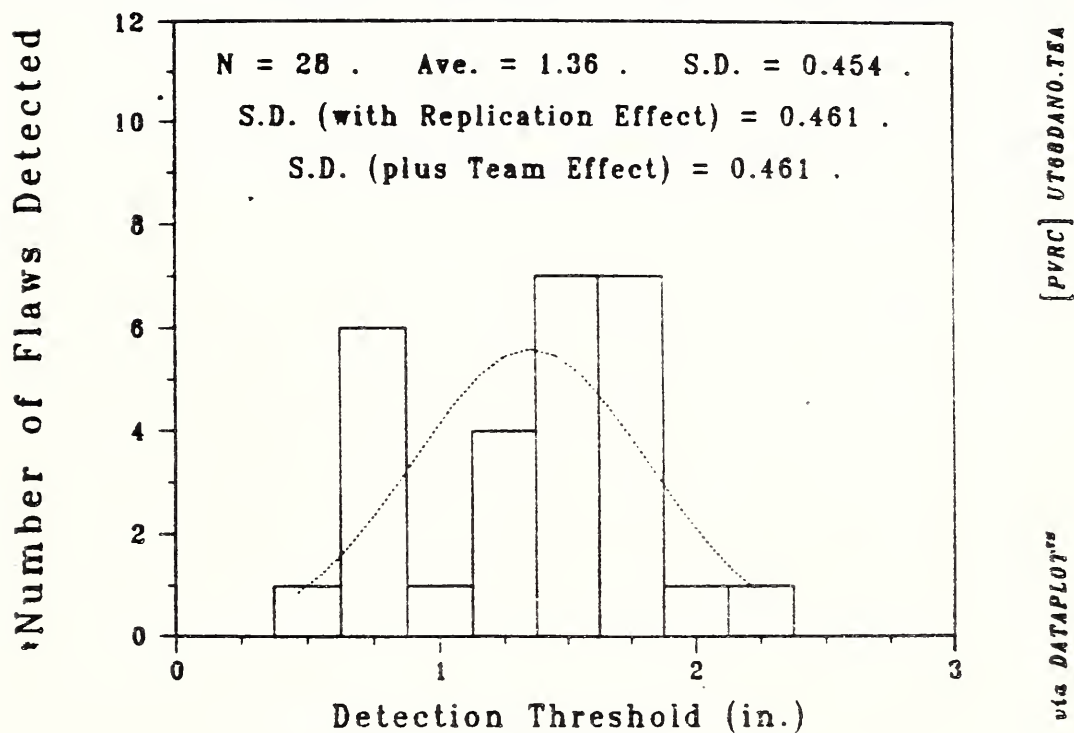


Fig. 49

Analysis of Variance (ANOVA) for Estimating  
Between-Team Effect on Detection for the 3-Team  
Threshold Data.

# UT-1968 Data: Flawtype Effect on Detection

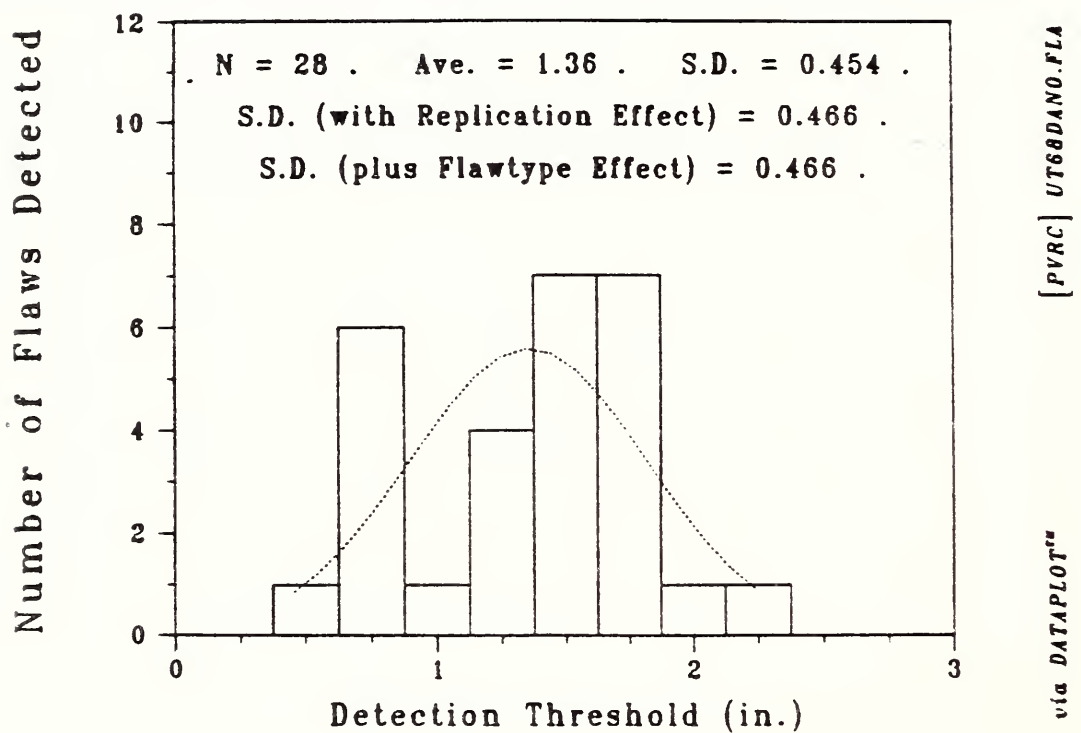


Fig. 50

Analysis of Variance (ANOVA) for Estimating Flawtype Effect on Detection for the 3-Team Threshold Data.

# UT-1968 Data: DAC Effect on Detection

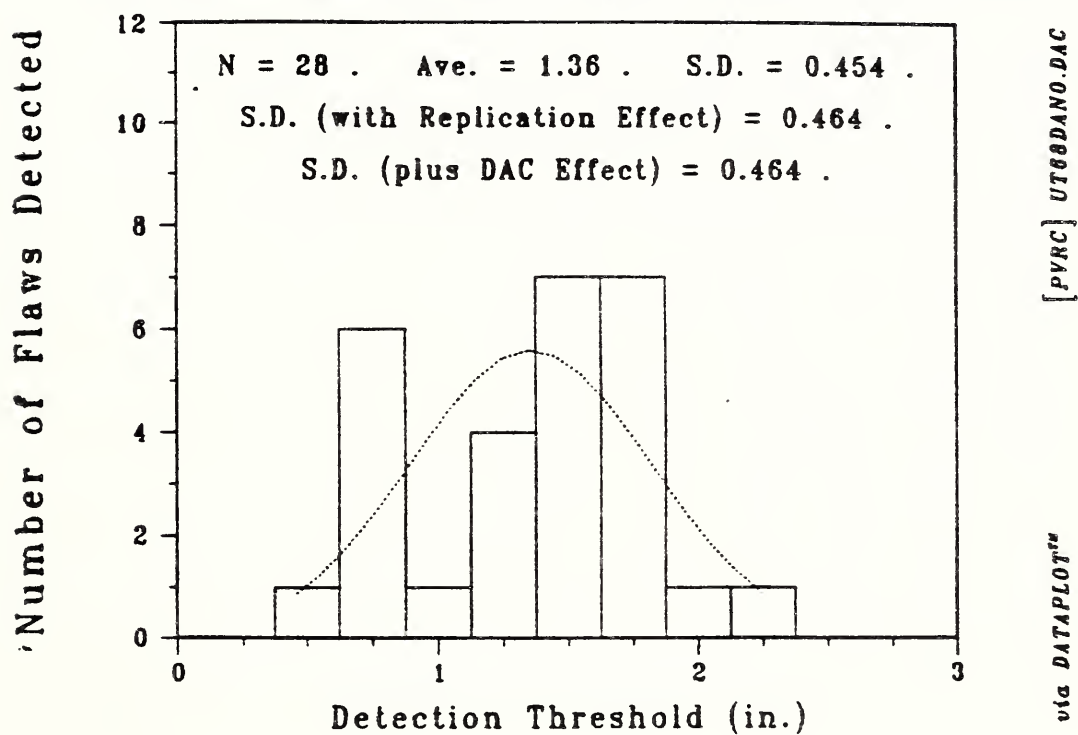


Fig. 51 Analysis of Variance (ANOVA) for Estimating DAC Effect on Detection for the 3-Team Threshold Data.


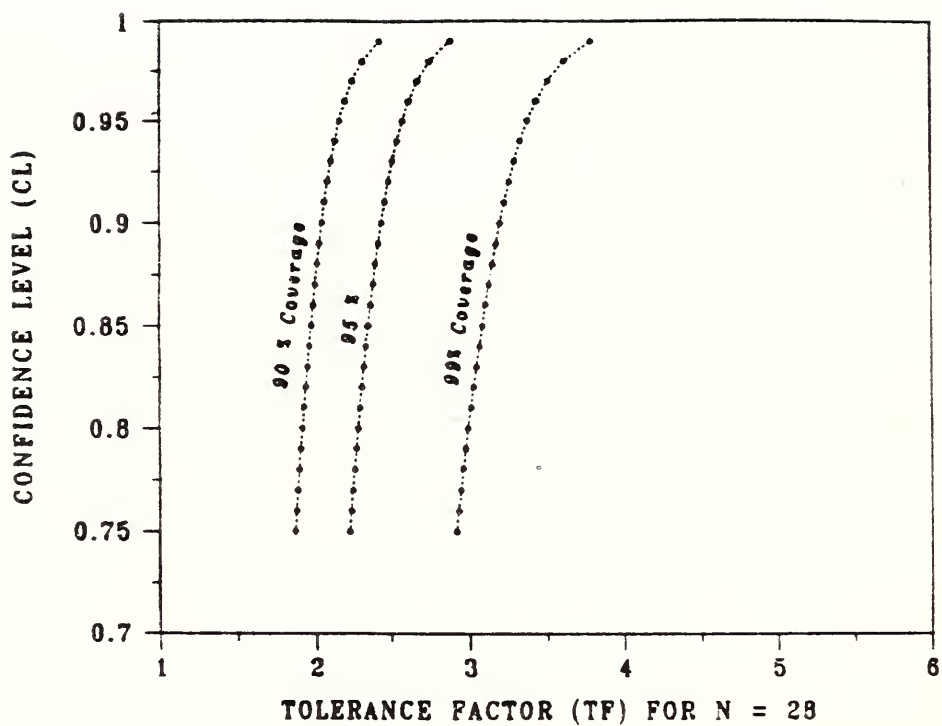


Fig. 52

Tolerance Factors (TF or K) for Sample Size  $N=28$  and 3 population coverages (90%, 95%, & 99%), as interpolated from Tables 4, 5, & 6 (Beyer, 1966).

## UT-1968 Detection Reliability

No. of Flaws = 15. No. of Types = 4.  
No. of Teams = 3. No. of Hits = 28.

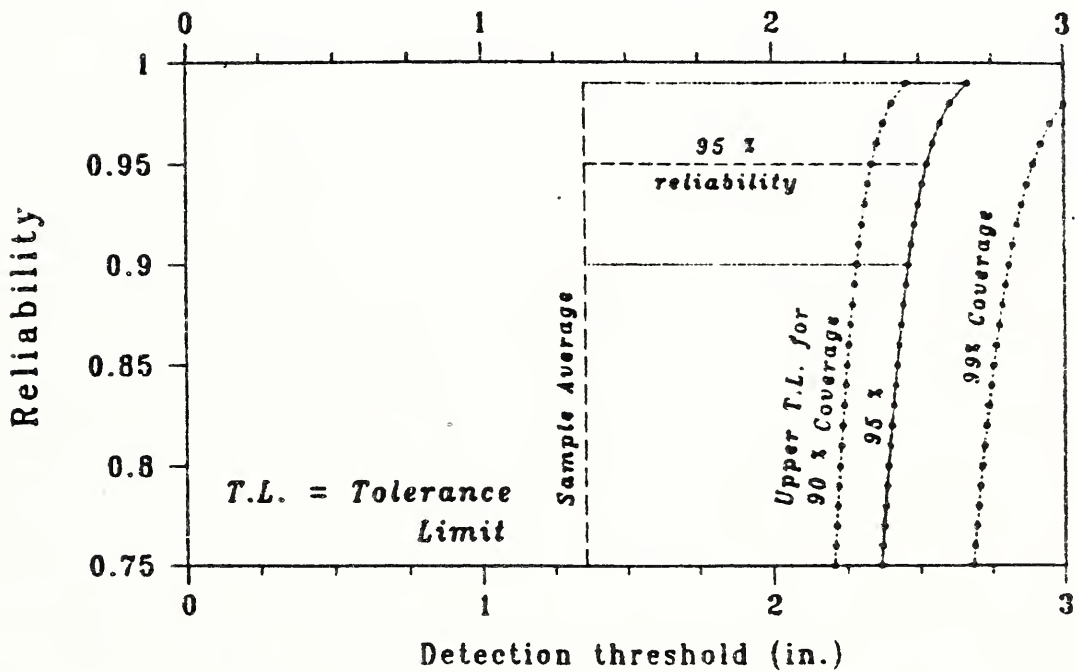

[PVRC] UT68DET2.DP  
via DATAPLOT™

Fig. 53

Reliability of Ultrasonic Detection (1968 Procedure) of Weld Flaws As Defined by the Upper Tolerance Limit Curves for Threshold & 3 Coverages







